

SEMATECH  
S2-93, S8-95

SEMI Standard  
S2-0703, S8-0701, F47-0200



Circulating fluid temperature controller

# Water-cooled Thermo-chiller

Refrigerant-free and energy saving type using no compressor.  
Ideal for ordinary temperature and high temperature processes.

- Circulating fluid types: Fluorinated fluids/Ethylene glycol aqueous solution/Clean water, Deionised water
- Temperature range setting: **20 to 90°C**
- Cooling capacity: **2 kW / 8 kW / 15 kW / 30 kW**
- Temperature stability: **±0.3°C**

More effective energy-saving  
through use of an **inverter** pump



Inverter type

Power consumption

**0.5 kWh/h**

Facility water

**1.2 L/min**

Series **HRW**

  
CAT.EUS40-53Aa-UK


# Energy Saving and Refrigerant-free

## Energy-saving and refrigerant-free (Ordinary temperature up to 90°C)

The water-cooled Thermo-chiller which does not use a compressor (refrigerant-free) is suitable for processes operating from ordinary temperature to 90°C. The energy-savings shown below can be achieved in comparison with existing models (depending on the conditions).

### Power consumption: Max. 59% reduction (SMC comparison)


The power consumption can be reduced by direct heat exchange between the circulating fluid and facility water with no refrigerating circuit.

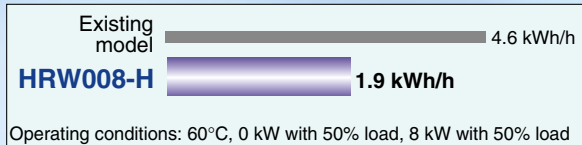

- Reduced running cost
- Contribution to the environmental preservation

### Circulating fluid: Max. 13% reduction (SMC comparison)

Enhanced temperature control technology and the unique pump/tank construction achieved the reduced circulating fluid required for operation.

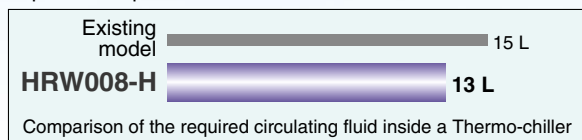


- Reduced initial cost
- Contribution to the environmental preservation


## Pump Inverter Type

More effective energy-saving is achieved through use of an **inverter pump**.


### Power consumption: Max. 89% reduction (SMC comparison)

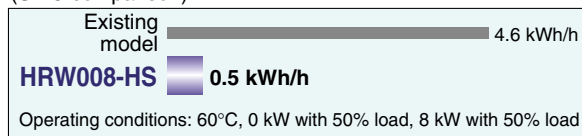

### Facility water: Max. 89% reduction (SMC comparison)

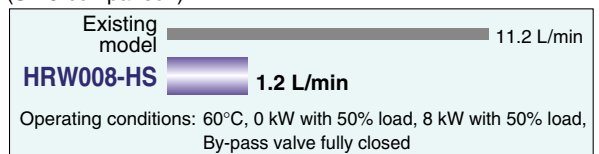

- Reduced facilities investment
- Space saved facility water equipment
- Reduced running cost

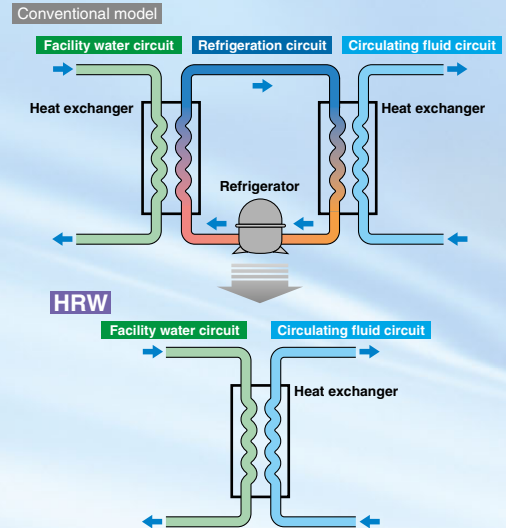

# Space Saving

## Installation area: max. 45% reduction (SMC comparison)


### (Forced exhaust from rear side)

By emitting the heat from the back, ventilation slits on the side are unnecessary offering reduced installation space.

Thermo-chiller with exhaust from the side:

Body space: W400 mm x D845 mm  
Ventilation space: 100 mm


**HRW008-H** : Body space: W380 mm x D665 mm  
Ventilation space: 0

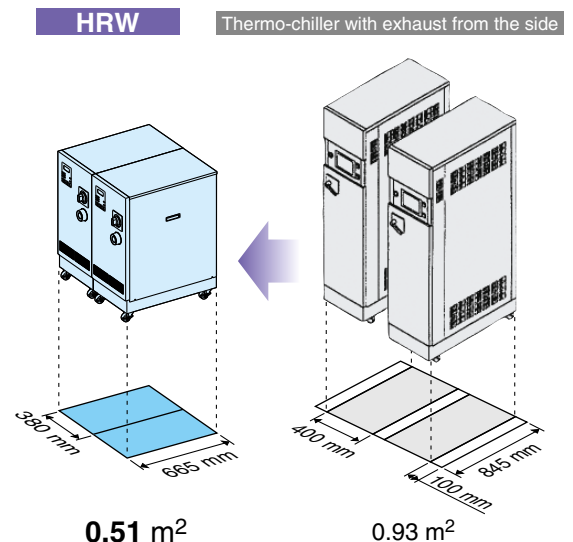

## High Performance


### Temperature stability: $\pm 0.3^{\circ}\text{C}$ (when a load is stable)

Enhanced temperature control technology achieved.  $\pm 0.3^{\circ}\text{C}$  temperature stability when a load is stable.

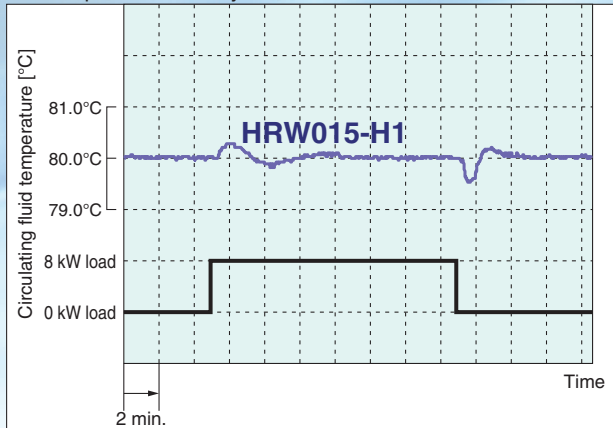


### Cooling capacity: max. 30 kW

Up to 30 kW cooling capacity achieved.

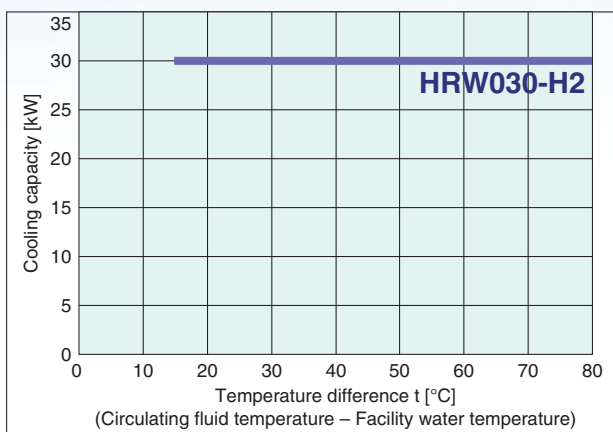


## Ease of maintenance

- Checking the electrical component parts accessible from the front side only



- Possible to replace the maintenance parts (such as a pump) without removing the pipings and discharging the circulating fluid.




- Various alarm displays (Refer to page 20.)

## Ease of Maintenance


### Circulating fluid automatic recovery function (Refer to "Options" on page 23.)

Circulating fluid inside a thermo-chiller tank can be recovered automatically. (Recovery volume: 12 L)


- Reduced maintenance time
- Faster operation
- Reduced circulating liquid loss by evaporation or spill.

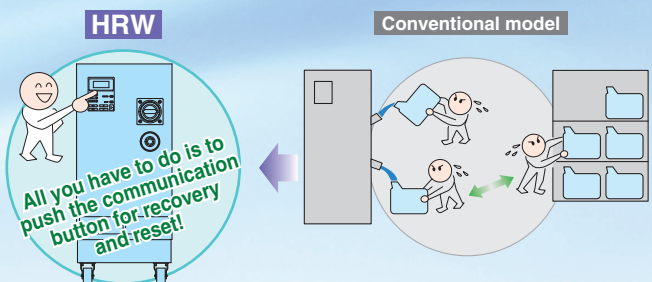


#### 1 Normal operation

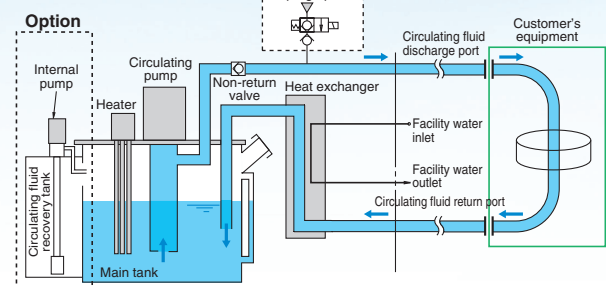

#### 2 Recovery of the circulating fluid

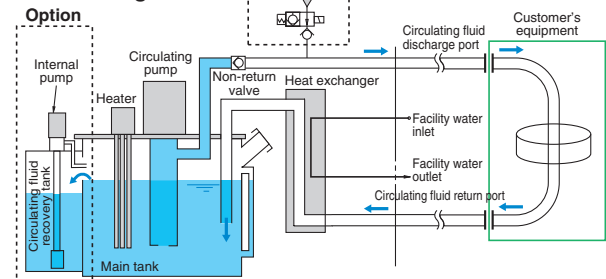

#### 3 Fluid returns to the main tank from the circulating fluid recovery tank.

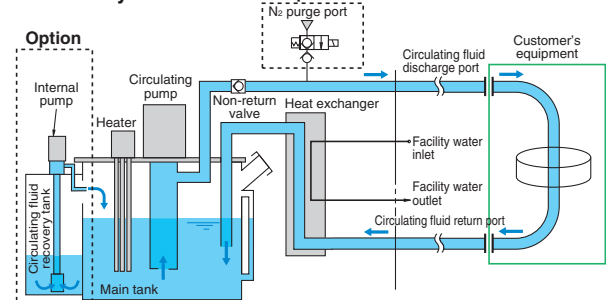

### Circulating fluid electric resistivity control function

(Refer to "Options" on page 22.)


(DI control kit)

## Electric Resistivity Control

### (DI control kit)

(Refer to "Options" on page 22.)

The electric resistivity of the circulating fluid (ethylene glycol aqueous solution and DI water) can be controlled.

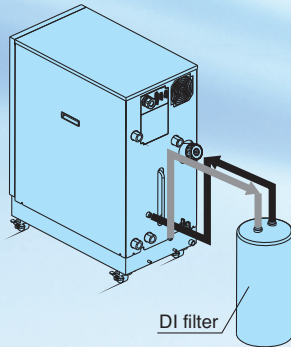

## Communication

- Contact input/output signal
- Serial RS-485 communication
- Analogue communication (Refer to "Options" on page 21.)
- DeviceNet communication (Refer to "Options" on page 21.)

### DeviceNet<sup>®</sup>

#### ■ Trademark

DeviceNet<sup>®</sup> is a registered trademark of ODVA, Inc.

### The wetted parts adopt the materials compatible for various circulating fluids.


(Stainless steel, EPDM, etc.)

- Fluorinated fluids: GALDEN<sup>®</sup> HT200  
Flourinert<sup>™</sup> FC-40
- Ethylene glycol aqueous solution 60%
- Deionised water / Clean water

Regarding a fluid other than the above, please contact SMC.

Flourinert<sup>™</sup> is a trademark of 3M. GALDEN<sup>®</sup> is a registered trademark of Solvay Solexis, Inc.

## Construction and Principles

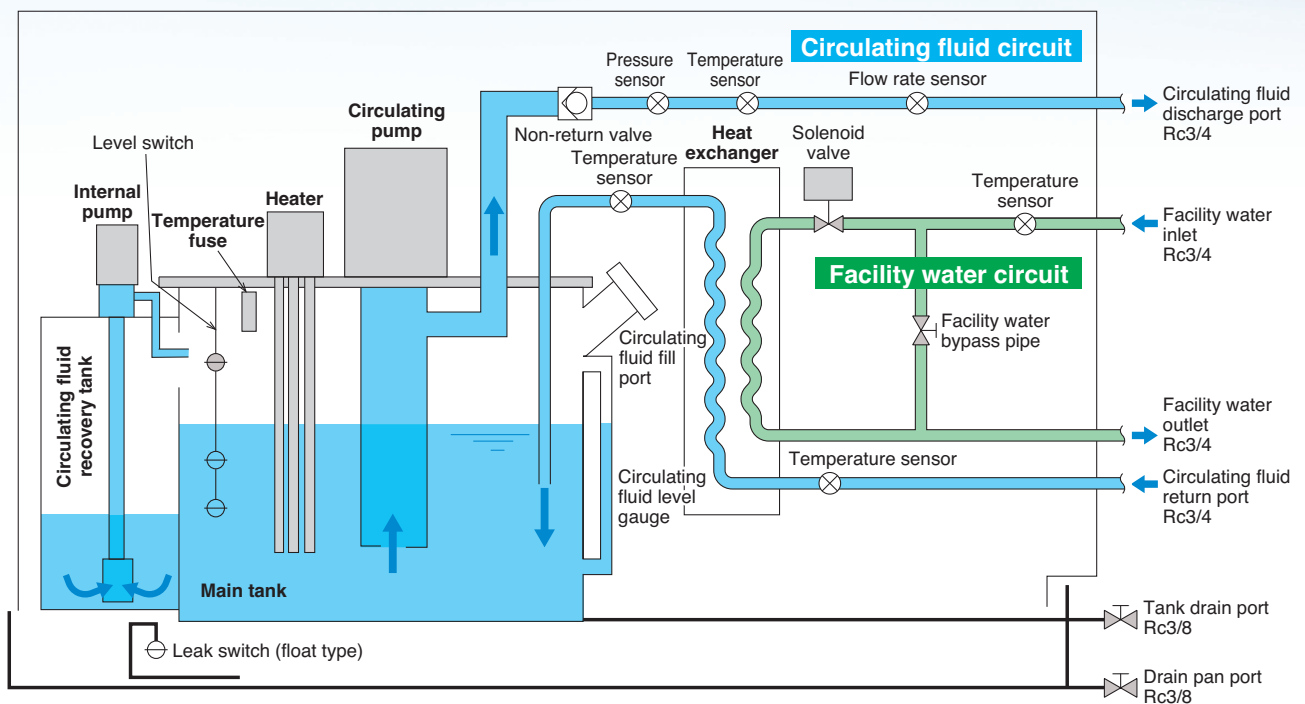

### Circulating fluid circuit

With the **circulating pump**, the circulating fluid will be discharged to the customer's equipment side. After the circulating fluid heats or cools the customer's equipment side, it is returned to the **main tank** via the **heat exchanger**. When the automatic circulating fluid recovery function, which recovers the circulating fluid from the customer's machine, is selected (refer to page 2), a **sub tank** for recovery is installed. The **internal pump** is used to transfer a circulating fluid from the **sub tank** to the **main tank**.


### Facility water circuit

When the circulating fluid temperature rises higher than the set temperature, open the **solenoid valve** to introduce facility water to the **heat exchanger**. When the circulating fluid temperature falls below the set temperature, close the **solenoid valve** to shut off the facility water to the **heat exchanger**.

# Application Examples

## Semiconductor


Example: Temperature control of a chamber electrode

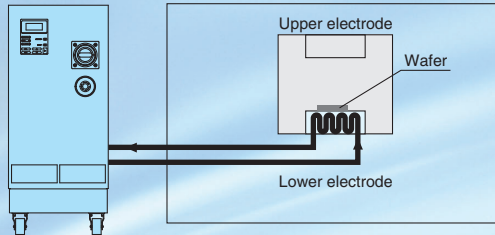

- Etching equipment
- Coating equipment
- Spatter equipment
- Dicing equipment
- Cleaning equipment
- Tester, etc.

## Medical


Example: Blood preservation

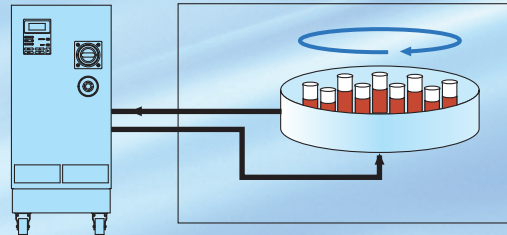

- X-ray instrument
- MRI
- Blood preservation equipment

## Food

Example: Tofu (Bean curd) production

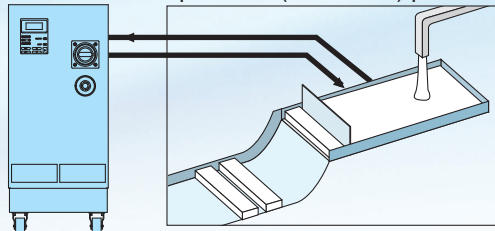


- Bottle-cleaning machine
- Tofu (Bean curd) production equipment
- Noodle-making machine, etc.

Water temperature control for forming tofu by mixing the boiled soybean milk and bitter

## Diagnosis

Example: Electronic microscope

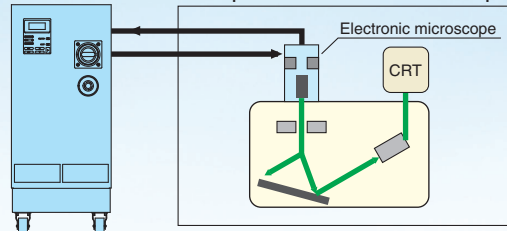


- Electron microscope
- X-ray diagnosis instrument
- Gas chromatography
- Sugar level analytical instrument, etc.

Prevents the distortion caused by the heat generated by the electronic gun in an electronic microscope.

## Machine tool

Example: Laser machining

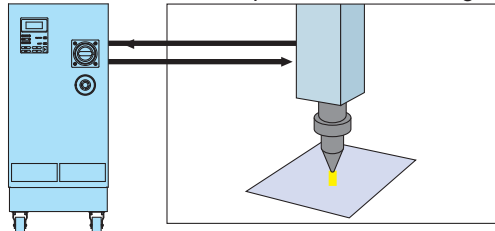


- Wire cutting
- Grinder
- Spot welding
- Plasma welding
- Laser machining, etc.

Temperature-controlling the laser generating tube enables the laser wavelength to be optimised, improving the accuracy of the machined cross sectional area.

## Printing

Example: Printing temperature control

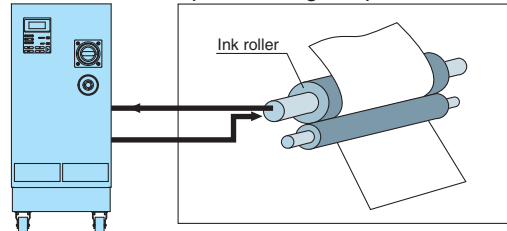


- Offset printing machine
- Automatic developing machine
- UV equipment, etc.

Temperature-controlling the ink roller enables to control the evaporation amount and viscosity of an ink and optimise the tint of colours.

## Molding

Example: Injection molding

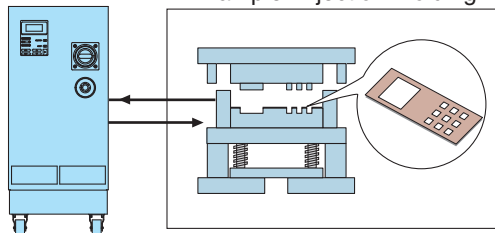

- Plastic molding
- Rubber molding
- Wire cable coating machine
- Injection molding, etc.

Temperature-controlling the mold results in improved product quality.



# CONTENTS

Model Selection	
• Guide to Model Selection .....	Page 7
• Calculation of Required Cooling Capacity .....	Page 8, 9
• Precautions on Model Selection .....	Page 9
• Circulating Fluid Representative.....	Page 10
Physical Property Values	
● <b>Fluorinated Fluid Type</b>	
How to Order/Specifications .....	Page 11
Cooling Capacity/Heating Capacity/ .....	Page 12
Pump Capacity	
● <b>Ethylene Glycol Type</b>	
How to Order/Specifications .....	Page 13
Cooling Capacity/Heating Capacity/ .....	Page 14
Pumping Capacity	
● <b>Clean/DI Water Type</b>	
How to Order/Specifications .....	Page 15
Cooling Capacity/Heating Capacity/ .....	Page 16
Pumping Capacity	
● <b>Common Specifications</b>	
Dimensions .....	Page 17
Communications .....	Page 18
• Contact Input/Output .....	Page 18
• Serial RS-485 .....	Page 19
• Connector Location .....	Page 19
Operation Panel Display .....	Page 20
Alarm .....	Page 20
● <b>Options</b>	
• Analogue Communication .....	Page 21
• DeviceNet™ Communication .....	Page 21
• NPT Fitting .....	Page 21
• DI Control Kit .....	Page 21
• Circulating Fluid Automatic Recovery ....	Page 22
● <b>Optional Accessories</b>	
• Bypass Piping Set .....	Page 23
• Anti-quake Bracket .....	Page 23
• 4 Port Manifold .....	Page 24
• DI Filter .....	Page 24
• Insulating Material for DI Filter .....	Page 24
• Contaminant Filter .....	Page 25
• 60% Ethylene Glycol Aqueous Solution .....	Page 25
• Concentration Meter .....	Page 25
Specific Product Precautions .....	Page 26

# Series HRW

## Model Selection

### Guide to Model Selection

#### 1. How much is the temperature in degrees centigrade for the circulating fluid?


Temperature range which can be set with the thermo-chiller

H: 20°C to 90°C

Example) Requirement from customer: 50°C

#### 2. What kind of the circulating fluid will be used?

Relationship between circulating fluid (which can be used with the thermo-chiller) and temperature

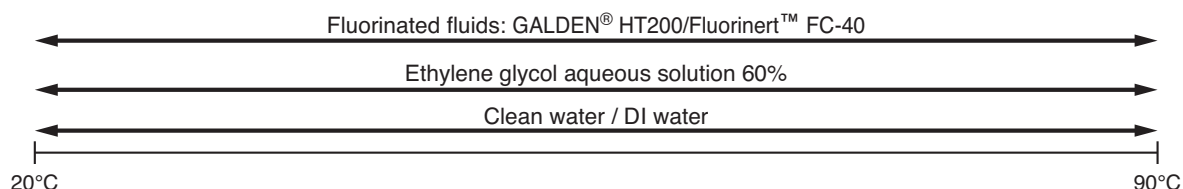

Example) Requirement from customer: Clean water

#### 3. How much is the temperature in degrees centigrade for the facility water?

Temperature range which can be set with the thermo-chiller

10°C to 35°C

Example) Facility water temperature of the customer's equipment: 15°C


Temperature difference between the circulating fluid and the facility water is:  $50 - 15 = 35^\circ\text{C}$ .

#### 4. What is the kW for the required cooling capacity?

Example) Requirement from customer: 20 kW

Plot the point where the temperature difference between the circulating fluid and the facility water (35°C) intersects the cooling capacity (20 kW) on the cooling capacity graph.

[Cooling capacity graph] Circulating fluid: Clean water / Deionised water

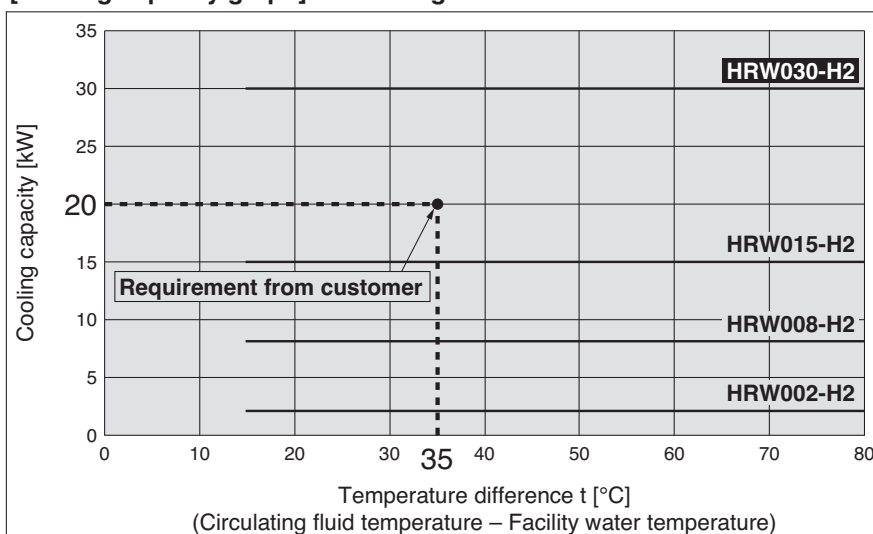

The point plotted in the graph is the requirement from your customer. Select the thermo-chiller models exceeding this point. In this case, select the **HRW030-H2**.

## Calculation of the Required Cooling Capacity

### Example 1: When the heat generation amount in the customer's equipment is known.

Heat generation amount Q: 3.5 kW

Cooling capacity = Considering a safety factor of 20%,  $3.5 \times 1.2 = 4.2 \text{ kW}$

### Example 2: When the heat generation amount in the customer's equipment is not known.

Obtaining the temperature difference between the inlet and the outlet by circulating the circulating fluid inside the customer's equipment.

Heat generation amount Q : Unknown  
 Circulating fluid temperature difference  $\Delta T (= T2 - T1)$ : 6.0°C (6.0 K)  
 Circulating fluid outlet temperature T1 : 20°C (293.15 K)  
 Circulating fluid return temperature T2 : 26°C (299.15 K)  
 Circulating fluid flow rate L : 20 L/min  
 Circulating fluid : Fluorinated fluid  
 Density  $\gamma$ :  $1.80 \times 10^3 \text{ kg/m}^3$   
 Specific heat C:  $0.96 \times 10^3 \text{ J/(kg} \cdot \text{K)}$  (at 20°C)

\* Refer to the information shown on page 10 highlighting the representative physical property values per circulating fluid.

$$Q = \frac{\Delta T \times L \times \gamma \times C}{60 \times 1000}$$

$$= \frac{6.0 \times 20 \times 1.80 \times 10^3 \times 0.96 \times 10^3}{60 \times 1000}$$

$$= 3456 \text{ W} = 3.5 \text{ kW}$$

Cooling capacity = Considering a safety factor of 20%,  
 $3.5 \times 1.2 = 4.2 \text{ kW}$

Example of the conventional measurement units (Reference)

Unknown  
 6.0°C  
 20°C  
 26°C  
 1.2 m³/h  
 Fluorinated fluid  
 Density  $\gamma$ :  $1.80 \times 10^3 \text{ kg/m}^3$   
 Specific heat C: 0.23 kcal/kg·°C (at 20°C)


\* Refer to the information shown on page 10 highlighting the representative physical property values per circulating fluid.

$$Q = \frac{\Delta T \times L \times \gamma \times C}{860}$$

$$= \frac{6.0 \times 1.2 \times 1.80 \times 10^3 \times 0.23}{860}$$

$$= 3.5 \text{ kW}$$

Cooling capacity = Considering a safety factor of 20%,  
 $3.5 \times 1.2 = 4.2 \text{ kW}$

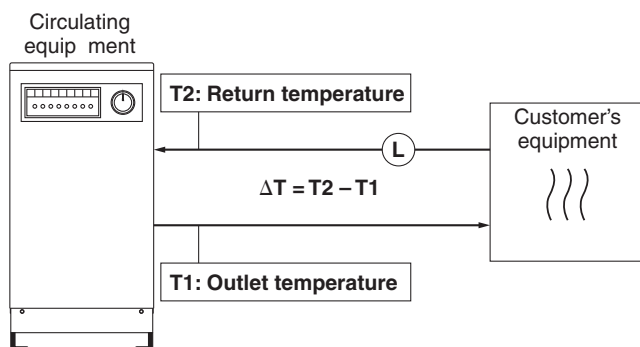

# Model Selection

## Calculation of the Required Cooling Capacity

### Example 3. When there is no heat generation, and when cooling the object below a certain temperature and period of time.

Total volume of the object being cooled down V : 60 L  
 Cooling time h : 15 min  
 Cooling temperature difference  $\Delta T$ : 20°C (20 K) (70°C – 50°C → 20°C)  
 Facility water temperature : 20°C (293.15 K)  
 Circulating fluid : Fluorinated fluid  
 Density  $\gamma$ : 1.74 x 10<sup>3</sup> kg/m<sup>3</sup>  
 Specific heat C: 1.05 x 10<sup>3</sup> J/(kg·K) (at 50°C)

\* Refer to the information shown on page 10 highlighting the representative physical property values per circulating fluid.

$$Q = \frac{\Delta T \times V \times \gamma \times C}{h \times 60 \times 1000}$$


$$\frac{20 \times 60 \times 1.74 \times 10^3 \times 1.05 \times 10^3}{15 \times 60 \times 1000} = 2436 \text{ W} = 2.4 \text{ kW}$$

Cooling capacity = Considering a safety factor of 20%,

$$2.4 \times 1.2 = 2.9 \text{ kW (When the circulating fluid temperature is 50°C.)}$$

(In this case, the selected thermo-chiller model will be HRW008-H.)

Circulating equipment

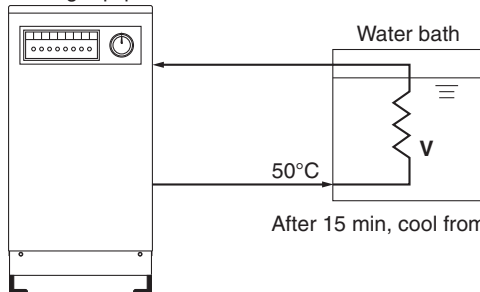

Note) This is the calculated value by changing the fluid temperature only.  
 Thus, it varies substantially depending on the water bath, piping material or shape.

Example of the conventional measurement units (Reference)

0.06 m<sup>3</sup>  
 0.25 h  
 20°C  
 20°C  
 Fluorinated fluid  
 Density  $\gamma$ : 1.74 x 10<sup>3</sup> kg/m<sup>3</sup>  
 Specific heat C: 0.25 kcal/kg·°C (at 50°C)

\* Refer to the information shown on page 10 highlighting the representative physical property values per circulating fluid.

$$Q = \frac{\Delta T \times V \times \gamma \times C}{h \times 860}$$

$$= \frac{20 \times 0.06 \times 1.74 \times 10^3 \times 0.25}{0.25 \times 860}$$

$$= 2.4 \text{ kW}$$

Cooling capacity = Considering a safety factor of 20%,

$$2.4 \times 1.2 = 2.9 \text{ kW (When the circulating fluid temperature is 50°C.)}$$

(In this case, the selected thermo-chiller model will be HRW008-H.)

## Precautions on Model Selection

### 1. Temperature difference between the circulating fluid and the facility water

The HRW series exchanges heat between the circulating fluid and the facility water directly, so it may not be possible to lower the circulating fluid temperature to the set temperature if the facility water temperature is too high. Check that the facility water temperature can be maintained for the circulating fluid temperature referring to the cooling capacity graph of each model before using.

### 2. Heating capacity

When setting the circulating fluid temperature at a temperature higher than room temperature, the circulating fluid will be heated with the thermo-chiller. The heating capacity varies depending on the circulating fluid temperature. Also, the heating capacity varies depending on the circulating fluid temperature. Consider the heat radiation amount or thermal capacity of the customer's equipment. Confirm beforehand if the required heating capacity is provided, basing on the heating capacity graph for the respective model.

### 3. Pumping capacity

#### <Circulating fluid flow>

The pumping capacity varies depending on the model selected from the HRW series. Also, the circulating fluid flow varies depending on the circulating fluid discharge pressure. Consider the installation height difference between our thermo-chiller and the customer's equipment, and the piping resistance such as circulating fluid pipings, or piping size, or piping curves in the equipment. Confirm beforehand if the required flow is achieved using the pumping capacity curves for each model respectively.

#### <Circulating fluid discharge pressure>

The circulating fluid discharge pressure has the possibility to increase up to the maximum pressure in the pumping capacity curves for each model. Confirm beforehand if the circulating fluid pipings or the circulating fluid circuit of the customer's equipment are fully durable against this pressure.

## Circulating Fluid Representative Physical Property Values

\* The below show reference values.  
For details, please contact the supplier  
of the circulating fluid.

### Fluorinated Fluids

Physical property value Temperature	Density $\gamma$	Specific heat C	
	[kg/m <sup>3</sup> ] [g/L]	[J/(kg·K)]	([kcal/kg·°C])
-10°C	1.87 x 10 <sup>3</sup>	0.87 x 10 <sup>3</sup>	0.21
20°C	1.80 x 10 <sup>3</sup>	0.96 x 10 <sup>3</sup>	0.23
50°C	1.74 x 10 <sup>3</sup>	1.05 x 10 <sup>3</sup>	0.25
80°C	1.67 x 10 <sup>3</sup>	1.14 x 10 <sup>3</sup>	0.27

### Ethylene Glycol Aqueous Solution 60%

Physical property value Temperature	Density $\gamma$	Specific heat C	
	[kg/m <sup>3</sup> ] [g/L]	[J/(kg·K)]	([kcal/kg·°C])
-10°C	1.10 x 10 <sup>3</sup>	3.02 x 10 <sup>3</sup>	0.72
20°C	1.08 x 10 <sup>3</sup>	3.15 x 10 <sup>3</sup>	0.75
50°C	1.06 x 10 <sup>3</sup>	3.27 x 10 <sup>3</sup>	0.78
80°C	1.04 x 10 <sup>3</sup>	3.40 x 10 <sup>3</sup>	0.81

### Water

Density  $\gamma$ : 1 x 10<sup>3</sup> [kg/m<sup>3</sup>] [g/L]

Specific heat C: 4.2 x 10<sup>3</sup> [J/(kg·K)] (1.0 [kcal/kg·°C])

# Thermo-chiller **Fluorinated Fluid Type**

## Series **HRW**



SEMI

### How to Order

Fluorinated Fluid Type

**HRW** **002** - H   -  

#### Cooling capacity

Symbol	Cooling capacity
<b>002</b>	2 kW
<b>008</b>	8 kW
<b>015</b>	15 kW
<b>030</b>	30 kW

#### Temperature range setting

Symbol	Temperature range setting
<b>H</b>	20 to 90°C

#### Option

Symbol	Option
—	None
<b>C</b>	Analogue communication
<b>D</b>	DeviceNet™ communication
<b>N</b>	NPT fitting
<b>W</b>	SI unit only
<b>Z</b>	Circulating fluid automatic recovery

#### Pump inverter control

Symbol	Pump inverter control
—	None
<b>S</b>	Applicable (Pump inverter type)

### Specifications (For details, please consult our "Product Specifications" information.)

Model		HRW002-H HRW002-HS	HRW008-H HRW008-HS	HRW015-H HRW015-HS	HRW030-H HRW030-HS	
Cooling method		Water-cooled				
Ambient temperature/humidity <sup>Note 1)</sup>		Temperature: 10 to 35°C, Humidity: 30 to 70%RH				
Circulating fluid system	Circulating fluid <sup>Note 2)</sup>	Fluorinert™ FC-40/GALDEN® HT200				
	Temperature range setting <sup>Note 1)</sup> [°C]	20 to 90				
	Cooling capacity (50/60 Hz common) [kW]	2	8	15	29	
	Conditions	Circulating fluid temperature [°C]	Facility water temperature +15			
		Facility water temperature [°C]	10 to 35			
		Circulating fluid rated flow [L/min]	4	30	40	40
		Facility water required flow rate [L/min]	10	20	25	40
	Temperature stability <sup>Note 3)</sup> [°C]	±0.3				
	Pump capacity <sup>Note 4)</sup> (50/60 Hz) [MPa]	0.40/0.60 (at 4 L/min)	0.45/0.65 (at 30 L/min)	0.40/0.60 (at 40 L/min)	0.40/0.60 (at 40 L/min)	
	Circulating fluid flow range <sup>Note 5)</sup> [L/min]	3 to 16	9 to 50			
	Tank capacity <sup>Note 6)</sup> [L]	Approx. 13		Approx. 14		
	Circulating fluid recovery tank volume <sup>Note 7)</sup> [L]	12				
Facility water system	Port size	Rc3/4				
	Wetted parts material	Copper brazing (Heat exchanger), Stainless steel, EPDM, Silicone, PPS, Fluororesin				
	Temperature range [°C]	10 to 35				
	Required flow rate <sup>Note 8)</sup> [L/min]	10	20	25	40	
	Inlet pressure range [MPa]	0.3 to 0.7				
Electrical system	Port size	Rc3/4				
	Wetted parts material	Copper brazing (Heat exchanger), Stainless steel, EPDM, Silicone, Bronze, Brass				
	Power supply	3-phase 200/200 to 208 VAC ±10%				
	Max. operating current [A]	26				
	Breaker capacity [A]	30				
Communications		Serial RS-485 (D-sub 9 pin) and Contact input/output (D-sub 25 pin)				
Dimensions <sup>Note 9)</sup> [mm]		W380 x D665 x H860				
Weight <sup>Note 10)</sup> [kg]	HRW□□□-H	Approx. 90		Approx. 100		
	HRW□□□-HS	Approx. 95		Approx. 105		
Safety standards		UL, CE/UKCA marking, SEMI (S2-0703, S8-1103, F47-0200), SEMATECH (S2-93, S8-95)				

Note 1) It should have no condensation.

Note 2) GALDEN® is a registered trademark, belonging to the Solvay Group or its corresponding owner. Fluorinert™ is a trademark of 3M. Regarding the fluid other than the above, please contact SMC.

Note 3) Outlet temperature when the circulating fluid and facility water are rated flow, and the circulating fluid outlet and return port are directly connected. Installation environment, power supply, and facility water are within specification range and stable. Value obtained 10 minutes after the external load is stabilised. It may be out of ±0.3°C in some other operating conditions.

Note 4) The capacity at the circulating fluid outlet when the circulating fluid temperature is 20°C. Pump capacity at 60 Hz indicates the maximum capacity of the HRW□□□-HS (pump inverter type).

Note 5) Applicable to the HRW□□□-HS (pump inverter type) only.

Note 6) Minimum volume required for operating only the Thermo-chiller. (Circulating fluid temperature: 20°C, including the Thermo-chiller's internal pipings or heat exchanger)

Note 7) The automatic circulating fluid recovering function will be provided by selecting option Z for collecting the circulating fluid inside an external piping.


Note 8) Required flow rate for cooling capacity or maintaining the temperature stability. The actual facility water flow rate will vary depending on the operating conditions.

Note 9) Panel dimensions. These dimensions do not include possible protrusions such as a breaker handle.

Note 10) Weight in the dry state without circulating fluids


## Cooling Capacity

HRW002-H/008-H/015-H/030-H  
HRW002-HS/008-HS/015-HS/030-HS

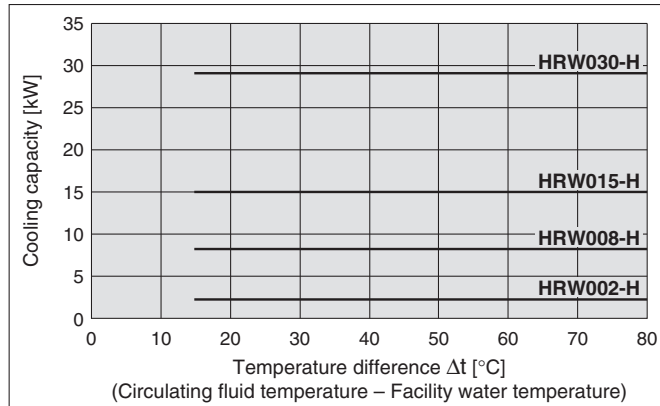

## Heating Capacity

HRW002-H/008-H/015-H/030-H  
HRW002-HS/008-HS/015-HS/030-HS

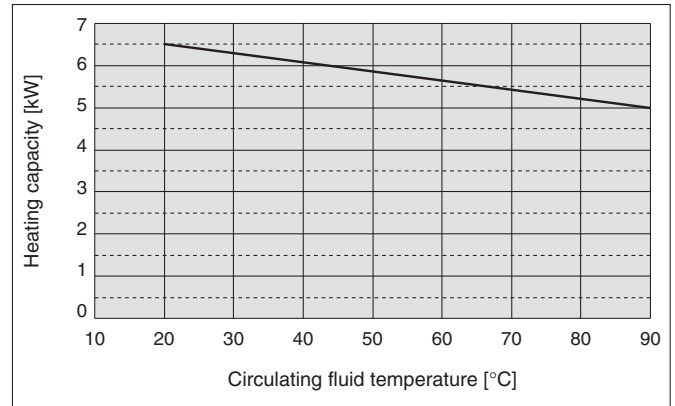


\* When pump inverter is operating at frequency of 60 Hz (maximum).

## Pump Capacity

HRW002-H  
HRW002-HS


Circulating fluid: Fluorinated fluids  
Circulating fluid temperature: 20°C

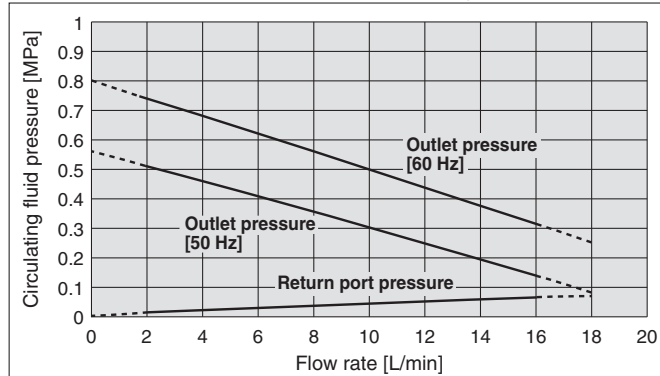

- \* If the circulating fluid flow drops below 2 L/min., the shutdown alarm activates and operation stops. Do not use the product when the flow exceeds 16 L/min., since the flow cannot be displayed accurately.
- \* Pump capacity at 60 Hz indicates the maximum capacity of the HRW002-HS (pump inverter type).

HRW008-H/015-H/030-H  
HRW008-HS/015-HS/030-HS

Circulating fluid: Fluorinated fluids  
Circulating fluid temperature: 20°C

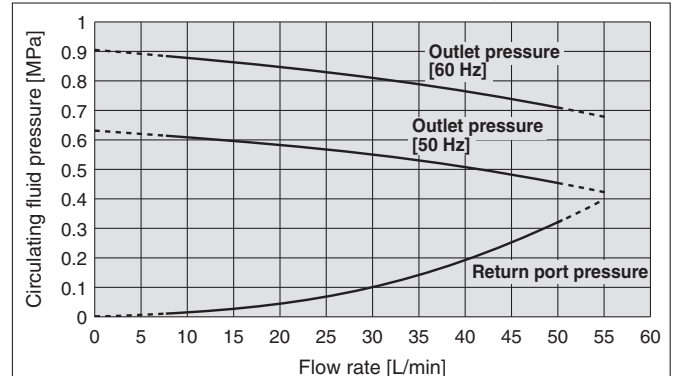

- \* If the circulating fluid flow drops below 8 L/min., the shutdown alarm activates and operation stops. Do not use the product when the flow exceeds 50 L/min., since the flow cannot be displayed accurately.
- \* Pump capacity at 60 Hz indicates the maximum capacity of the HRW008-HS/015-HS/030-HS (pump inverter type).

Fluorinated Fluid Type

Ethylene Glycol Type

Clean/DI Water Type

# Thermo-chiller Ethylene Glycol Type

## Series *HRW*



SEMI

### How to Order

Ethylene Glycol Type

HRW 002 - H 1

Cooling capacity

Symbol	Cooling capacity
002	2 kW
008	8 kW
015	15 kW
030	30 kW

Temperature range setting

Symbol	Temperature range setting
H	20 to 90°C

Ethylene glycol type

Option

Symbol	Option
—	None
C	Analogue communication
D	DeviceNet™ communication
N	NPT fitting
W	SI unit only
Y	DI control kit
Z	Circulating fluid automatic recovery

Pump inverter control

Symbol	Pump inverter control
—	None
S	Applicable (Pump inverter type)

### Specifications (For details, please consult our "Product Specifications" information.)

Model		HRW002-H1 HRW002-H1S	HRW008-H1 HRW008-H1S	HRW015-H1 HRW015-H1S	HRW030-H1 HRW030-H1S	
Cooling method		Water-cooled				
Ambient temperature/humidity <sup>Note 1)</sup>		Temperature: 10 to 35°C, Humidity: 30 to 70%RH				
Circulating fluid system	Circulating fluid <sup>Note 2)</sup>	60% ethylene glycol aqueous solution				
	Temperature range setting <sup>Note 1)</sup> [°C]	20 to 90				
	Cooling capacity (50/60 Hz common) [kW]	2	8	15	27	
	Conditions	Circulating fluid temperature [°C]	Facility water temperature +15			
		Facility water temperature [°C]	10 to 35			
		Circulating fluid rated flow [L/min]	4	15	30	40
		Facility water required flow rate [L/min]	10	15	25	40
	Temperature stability <sup>Note 3)</sup> [°C]	±0.3				
	Pump capacity <sup>Note 4)</sup> (50/60 Hz) [MPa]	0.35/0.55 (at 4 L/min)	0.45/0.65 (at 15 L/min)	0.40/0.60 (at 30 L/min)	0.35/0.55 (at 40 L/min)	
	Circulating fluid flow range <sup>Note 5)</sup> [L/min]	3 to 16	9 to 50			
	Tank capacity <sup>Note 6)</sup> [L]	Approx. 13				
	Circulating fluid recovery tank volume <sup>Note 7)</sup> [L]	12				
Facility water system	Port size	Rc3/4				
	Wetted parts material	Nickel brazing (Heat exchanger), Stainless steel, EPDM, Silicone, PPS, Fluororesin				
	Temperature range [°C]	10 to 35				
	Required flow rate <sup>Note 8)</sup> [L/min]	10	15	25	40	
	Inlet pressure range [MPa]	0.3 to 0.7				
Electrical system	Port size	Rc3/4				
	Wetted parts material	Nickel brazing (Heat exchanger), Stainless steel, EPDM, Silicone, Bronze, Brass				
	Power supply	3-phase 200/200 to 208 VAC ±10%				
	Max. operating current [A]	26				
	Breaker capacity [A]	30				
Dimensions	Communications	Serial RS-485 (D-sub 9 pin) and Contact input/output (D-sub 25 pin)				
	<sup>Note 9)</sup> [mm]		W380 x D665 x H860			
	<sup>Note 10)</sup> [kg]	HRW□□□-H	Approx. 90			
HRW□□□-HS		Approx. 95				
Safety standards		UL, CE/UKCA marking, SEMI (S2-0703, S8-1103, F47-0200), SEMATECH (S2-93, S8-95)				

Note 1) It should have no condensation.

Note 2) Dilute pure ethylene glycol with clear water. Additives invading wetting parts material such as preservatives cannot be used.

Note 3) Outlet temperature when the circulating fluid and facility water are rated flow, and the circulating fluid outlet and return port are directly connected. Installation environment, power supply, and facility water are within specification range and stable. Value obtained 10 minutes after the external load is stabilised (after stabilisation with no load for HRW030-H1). It may be out of this range when a DI control kit (option Y) is used or in some other operating conditions.

Note 4) The capacity at the circulating fluid outlet when the circulating fluid temperature is 20°C. Pump capacity at 60 Hz indicates the maximum capacity of the HRW□□□-H2S (pump inverter type).

Note 5) Applicable to the HRW□□□-H1S (pump inverter type) only.

Note 6) Minimum volume required for operating only the Thermo-chiller. (Circulating fluid temperature: 20°C, including the Thermo-chiller's internal pipings or heat exchanger)

Note 7) The automatic circulating fluid recovering function will be provided by selecting option Z for collecting the circulating fluid inside an external piping.


Note 8) Required flow rate for cooling capacity or maintaining the temperature stability. The actual facility water flow rate will vary depending on the operating conditions.

Note 9) Panel dimensions. These dimensions do not include possible protrusions such as a breaker handle.

Note 10) Weight in the dry state without circulating fluids


## Cooling Capacity

HRW002-H1/008-H1/015-H1/030-H1  
HRW002-H1S/008-H1S/015-H1S/030-H1S

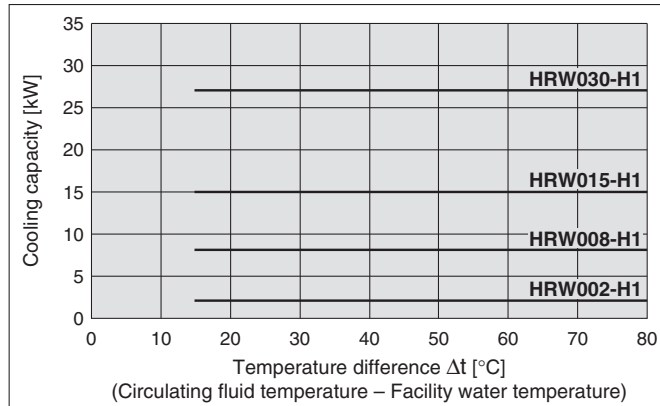

## Heating Capacity


HRW002-H1/008-H1/015-H1/030-H1  
HRW002-H1S/008-H1S/015-H1S/030-H1S

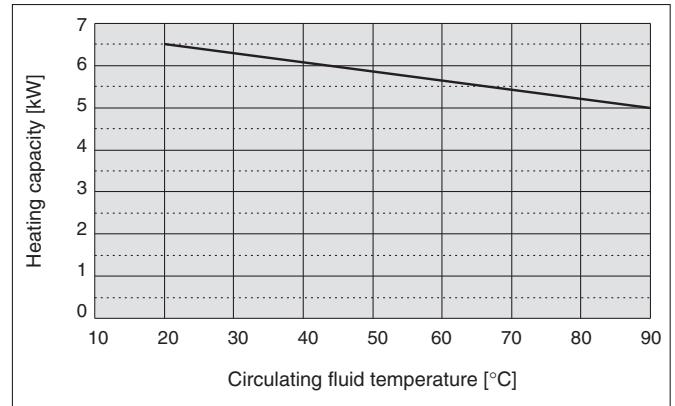

## Pump Capacity

HRW002-H1  
HRW002-H1S


Circulating fluid: 60% ethylene glycol  
Circulating fluid temperature: 20°C

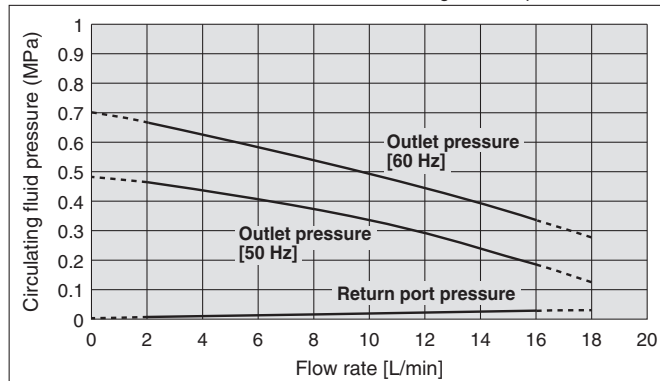

- \* If the circulating fluid flow drops below 2 L/min., the shutdown alarm activates and operation stops. Do not use the product when the flow exceeds 16 L/min., since the flow cannot be displayed accurately.
- \* Pump capacity at 60 Hz indicates the maximum capacity of the HRW002-H1S (pump inverter type).

HRW008-H1/015-H1/030-H1  
HRW008-H1S/015-H1S/030-H1S

Circulating fluid: 60% ethylene glycol  
Circulating fluid temperature: 20°C

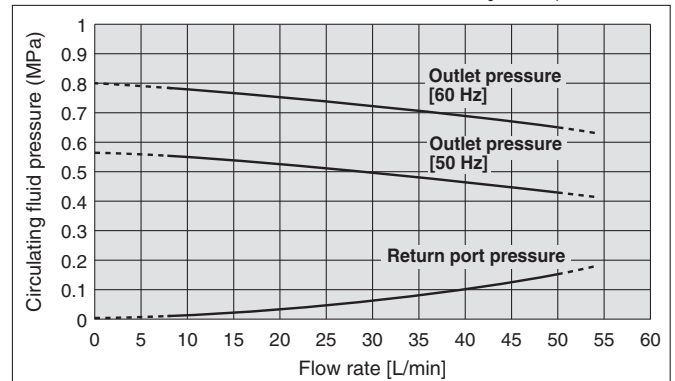

- \* If the circulating fluid flow drops below 8 L/min., the shutdown alarm activates and operation stops. Do not use the product when the flow exceeds 50 L/min., since the flow cannot be displayed accurately.
- \* Pump capacity at 60 Hz indicates the maximum capacity of the HRW008-H1S/015-H1S/030-H1S (pump inverter type).

Fluorinated Fluid Type

Ethylene Glycol Type

Clean/DI Water Type

# Thermo-chiller Clean/DI Water Type

## Series *HRW*



SEMI

### How to Order

#### Clear/Deionised Water Type

**HRW 002 - H 2**

#### Cooling capacity

Symbol	Cooling capacity
002	2 kW
008	8 kW
015	15 kW
030	30 kW

#### Temperature range setting

Symbol	Temperature range setting
H	20 to 90°C

#### Clear/Deionised water type

#### Option

Symbol	Option
—	None
C	Analogue communication
D	DeviceNet™ communication
N	NPT fitting
W	SI unit only
Y	DI control kit
Z	Circulating fluid automatic recovery

#### Pump inverter control

Symbol	Pump inverter control
—	None
S	Applicable (Pump inverter type)

### Specifications (For details, please consult our "Product Specifications" information.)

Model		HRW002-H2 HRW002-H2S	HRW008-H2 HRW008-H2S	HRW015-H2 HRW015-H2S	HRW030-H2 HRW030-H2S	
Cooling method		Water-cooled				
Ambient temperature/humidity <sup>Note 1)</sup>		Temperature: 10 to 35°C, Humidity: 30 to 70%RH				
Circulating fluid system	Circulating fluid <sup>Note 2)</sup>	Clear water, Deionised water				
	Temperature range setting <sup>Note 1)</sup> [°C]	20 to 90				
	Cooling capacity (50/60 Hz common) [kW]	2	8	15	30	
	Conditions	Circulating fluid temperature [°C]	Facility water temperature +15			
		Facility water temperature [°C]	10 to 35			
		Circulating fluid rated flow [L/min]	4	15	30	40
		Facility water required flow rate [L/min]	10	15	25	40
	Temperature stability <sup>Note 3)</sup> [°C]	±0.3				
	Pump capacity <sup>Note 4)</sup> (50/60 Hz) [MPa]	0.35/0.55 (at 4 L/min)	0.45/0.65 (at 15 L/min)	0.40/0.60 (at 30 L/min)	0.35/0.55 (at 40 L/min)	
	Circulating fluid flow range <sup>Note 5)</sup> [L/min]	3 to 16	9 to 50			
	Tank capacity <sup>Note 6)</sup> [L]	Approx. 13				
	Circulating fluid recovery tank volume <sup>Note 7)</sup> [L]	12				
Facility water system	Port size	Rc3/4				
	Wetted parts material	Nickel brazing (Heat exchanger), Stainless steel, EPDM, Silicone, PPS, Fluororesin				
	Temperature range [°C]	10 to 35				
	Required flow rate <sup>Note 8)</sup> [L/min]	10	15	25	40	
	Inlet pressure range [MPa]	0.3 to 0.7				
	Port size	Rc3/4				
Electrical system	Wetted parts material	Nickel brazing (Heat exchanger), Stainless steel, EPDM, Silicone, Bronze, Brass				
	Power supply	3-phase 200/200 to 208 VAC ±10%				
	Max. operating current [A]	26				
	Breaker capacity [A]	30				
	Communications	Serial RS-485 (D-sub 9 pin) and Contact input/output (D-sub 25 pin)				
Dimensions <sup>Note 9)</sup> [mm]		W380 x D665 x H860				
Weight <sup>Note 10)</sup> [kg]	HRW□□□-H	Approx. 90				
	HRW□□□-HS	Approx. 95				
Safety standards		UL, CE/UKCA marking, SEMI (S2-0703, S8-1103, F47-0200), SEMATECH (S2-93, S8-95)				

Note 1) It should have no condensation.

Note 2) If clear water or deionised water is used, please use water that conforms to Water Quality Standards of the Japan Refrigeration and Air Conditioning Industry Association (JRA GL-02-1994/cooling water system - circulation type - make-up water). The electrical conductivity of the deionised water used as the fluid varies depending on the operating conditions.

Note 3) Outlet temperature when the circulating fluid and facility water are rated flow, and the circulating fluid outlet and return port are directly connected. Installation environment, power supply, and facility water are within specification range and stable. Value obtained 10 minutes after the external load is stabilised (after stabilisation with no load for HRW030-H2). It may be out of this range when a DI control kit (option Y) is used or in some other operating conditions.

Note 4) The capacity at the circulating fluid outlet when the circulating fluid temperature is 20°C. Pump capacity at 60 Hz indicates the maximum capacity of the HRW□□□-H2S (pump inverter type).

Note 5) Applicable to the HRW□□□-H2S (pump inverter type) only.

Note 6) Minimum volume required for operating only the Thermo-chiller. (Circulating fluid temperature: 20°C, including the Thermo-chiller's internal pipings or heat exchanger)

Note 7) The automatic circulating fluid recovering function will be provided by selecting option Z for collecting the circulating fluid inside an external piping.


Note 8) Required flow rate for cooling capacity or maintaining the temperature stability. The actual facility water flow rate will vary depending on the operating conditions.

Note 9) Panel dimensions. These dimensions do not include possible protrusions such as a breaker handle.

Note 10) Weight in the dry state without circulating fluids


## Cooling Capacity

HRW002-H2/008-H2/015-H2/030-H2  
HRW002-H2S/008-H2S/015-H2S/030-H2S

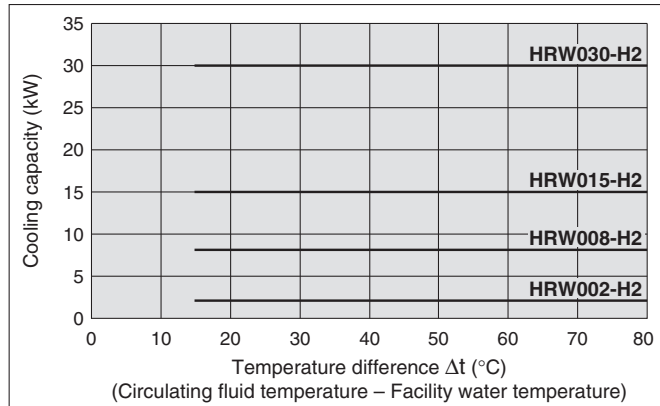

## Heating Capacity


HRW002-H2/008-H2/015-H2/030-H2  
HRW002-H2S/008-H2S/015-H2S/030-H2S

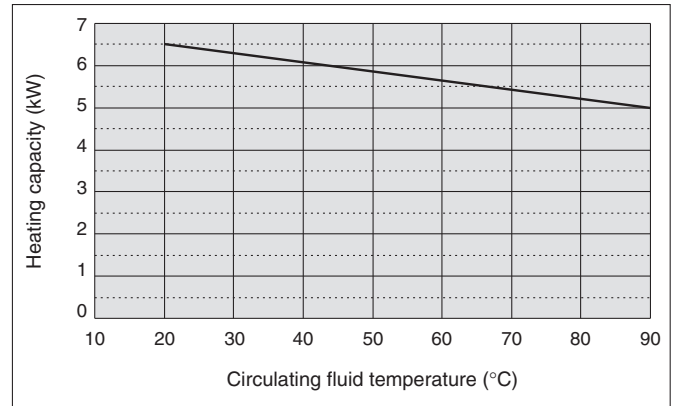

## Pump Capacity

HRW002-H2  
HRW002-H2S


Circulating fluid: Clear water  
Circulating fluid temperature: 20°C

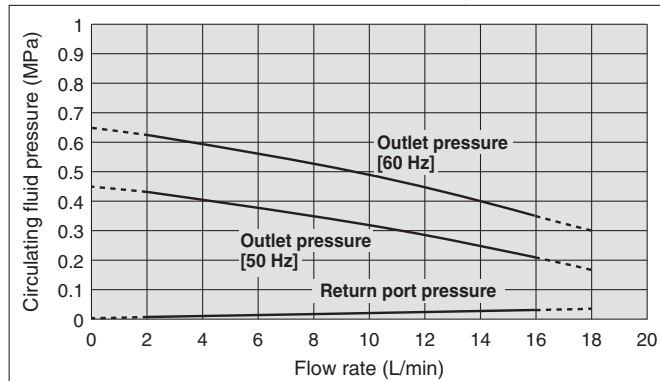

- \* If the circulating fluid flow drops below 2 L/min., the shutdown alarm activates and operation stops. Do not use the product when the flow exceeds 16 L/min., since the flow cannot be displayed accurately.
- \* Pump capacity at 60 Hz indicates the maximum capacity of the HRW002-H2S (pump inverter type).

HRW008-H2/015-H2/030-H2  
HRW008-H2S/015-H2S/030-H2S

Circulating fluid: Clear water  
Circulating fluid temperature: 20°C

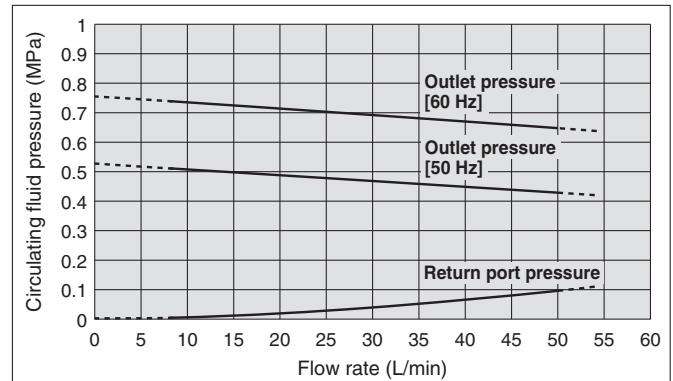

- \* If the circulating fluid flow drops below 8 L/min., the shutdown alarm activates and operation stops. Do not use the product when the flow exceeds 50 L/min., since the flow cannot be displayed accurately.
- \* Pump capacity at 60 Hz indicates the maximum capacity of the HRW008-H2S/015-H2S/030-H2S (pump inverter type).

Fluorinated Fluid Type


Ethylene Glycol Type

Clean/DI Water Type

# Series HRW

## Common Specifications

### Dimensions

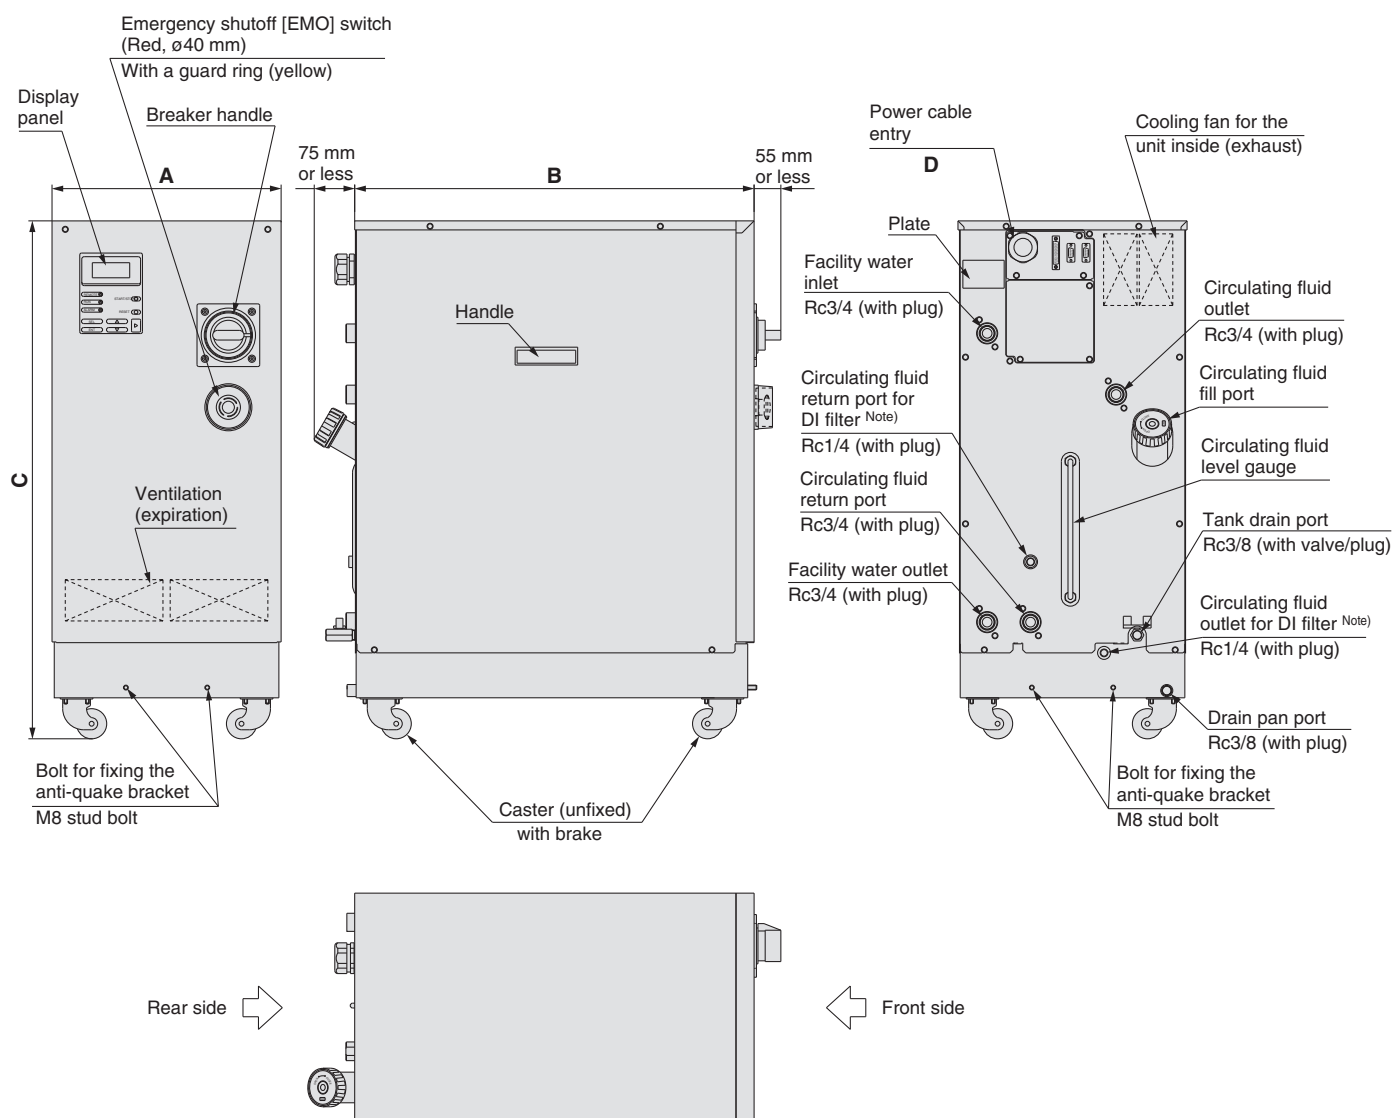

Note) Only when the DI control kit (Option "Y") is selected.


Model			[mm]			
Fluorinated fluid type	Ethylene glycol type	Clean/DI water type	A	B	C	D
HRW002-H	HRW002-H1	HRW002-H2	380	665	860	ø18.5 to 20.5
HRW008-H	HRW008-H1	HRW008-H2				
HRW015-H	HRW015-H1	HRW015-H2				
HRW030-H	HRW030-H1	HRW030-H2				

## Communications

(For details, please consult our "Communication Specifications" information.)

### Contact Input/Output

Item		Specifications
Connector no.		P1
Connector type (on this product side)		D-sub 25 P type, Female connector
Fixing bolt size		M2.6 x 0.45
Input signal	Insulation method	Photocoupler
	Rated input voltage	24 VDC
	Operating voltage range	21.6 to 26.4 VDC
	Rated input current	5 mA TYP
	Input impedance	4.7 kΩ
Output signal	Rated load voltage	48 VAC or less / 30 VDC or less
	Maximum load current (total)	When using the power supply of the thermo-chiller: DC 200 mA (resistance load / inductive load) When using the power supply of the customer's equipment: AC/DC 800 mA (resistance load / inductive load)
Alarm signal	Rated load voltage	48 VAC or less / 30 VDC or less
	Maximum load current	AC/DC 800 mA (resistance load / inductive load)
EMO signal	Rated load voltage	48 VAC or less / 30 VDC or less
	Maximum load current	AC/DC 800 mA (resistance load / inductive load)

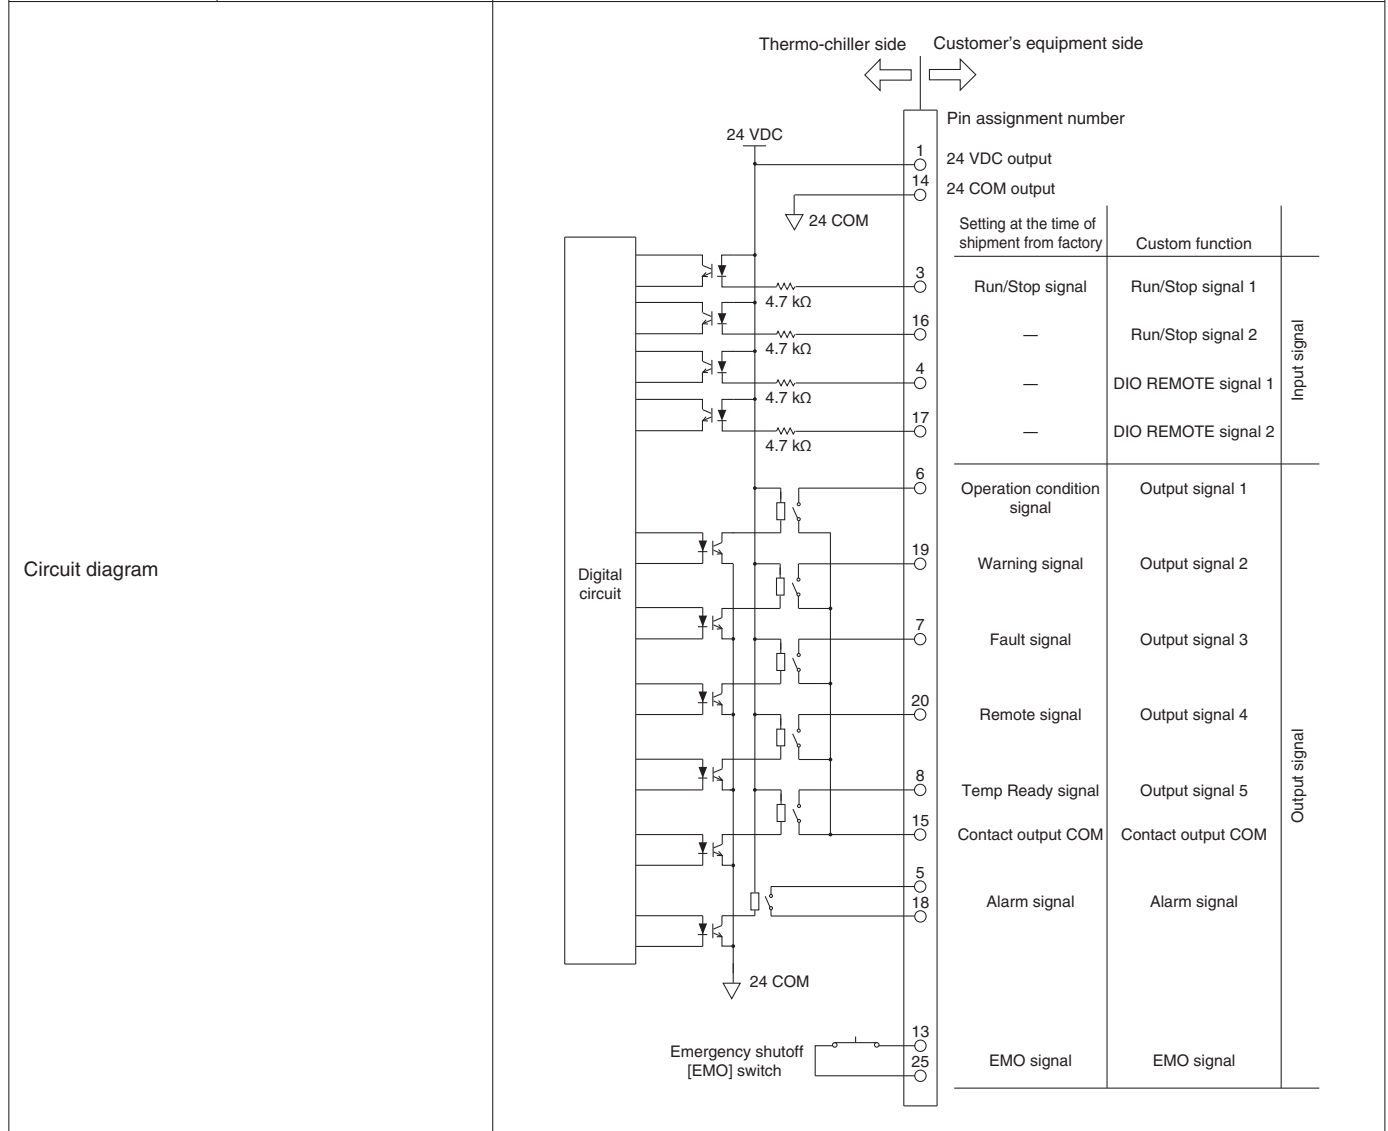

Note) The custom function is equipped for contact input/output. Using the custom function enables the customer to set the signal type for contact input/output or pin assignment numbers. For details, please consult "Communication Specifications" information.

**Communications** (For details, please consult our "Communication Specifications" information.)

**Serial RS-485**

The serial RS-485 enables the following items to be written and read out.

<Writing>

Run/Stop

Circulating fluid temperature setting

Circulating fluid automatic recovery start/stop\*1

<Readout>

Circulating fluid present temperature

Circulating fluid flow

Circulating fluid discharge pressure

Circulating fluid electric resistivity\*2

Alarm occurrence information

Status (operating condition) information

\*1 Only when the circulating fluid automatic recovery function (Option "Z") is selected.

\*2 Only when the DI control kit (Option "Y") is selected.

Item	Specifications
Connector no.	P2
Connector type (on this product side)	D-sub 9 P type, Female connector
Fixing bolt size	M2.6 x 0.45
Standard	EIA RS485
Protocol	Modicon Modbus
Circuit diagram	


**Connector location**

P3: Not used for the maintenance purpose port  
D-sub9 (Male receptacle)


P2: Serial RS-485  
D-sub9 (Female receptacle)

P1: Contact input/output  
D-sub25 (Female receptacle)

Power cable entry

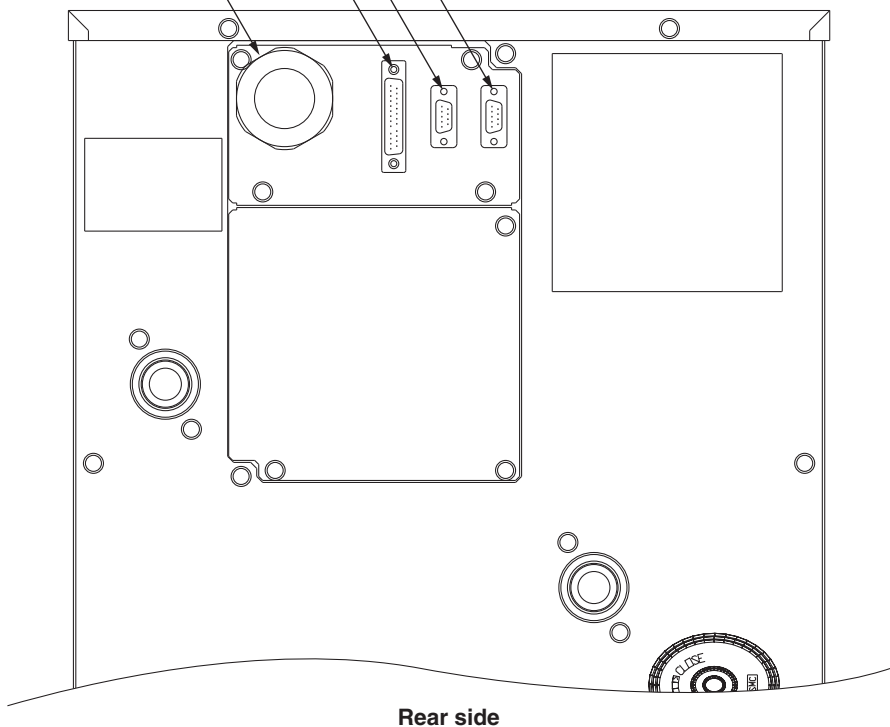

## Operation Panel Display

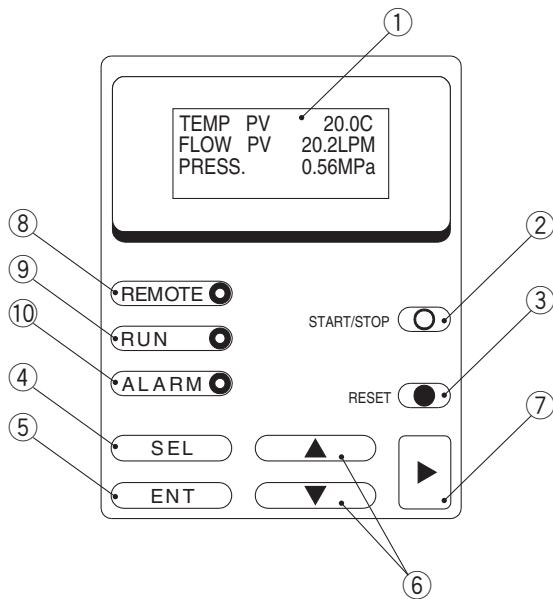

No.	Description	Function
①	<b>LCD screen</b>	Operating condition of this unit / Circulating fluid discharge temperature / Circulating fluid flow / Circulating fluid discharge pressure / Setting value / Alarm message, etc. are displayed.
②	<b>[START/STOP] key</b>	Starts/Stops the operation.
③	<b>[RESET] key</b>	Stops the alarm buzzing. Resets the alarm.
④	<b>[SEL] key</b>	Switches the display.
⑤	<b>[ENT] key</b>	Decides the settings.
⑥	<b>[▲] [▼] key</b>	Moves the cursor and changes the setting values.
⑦	<b>[▶] key</b>	Moves the cursor.
⑧	<b>[REMOTE] indicator</b>	Blinks when the unit is in the remote status.
⑨	<b>[RUN] indicator</b>	Blinks when the unit is in the operating status.
⑩	<b>[ALARM] indicator</b>	Blinks when the unit is alarming.

## Alarm

This unit can display 23 kinds of alarm messages as standard. Also, it can read out the serial RS-485 communication.

Alarm code	Alarm message	Operation status	Main reason
01	Water Leak Detect FLT	Stop	Liquid deposits in the drain pan of this unit.
02	Incorrect Phase Error FLT	Stop	The power supply to this unit is incorrect.
05	Reservoir Low Level FLT	Stop	The amount of circulating fluid tank is running low.
06	Reservoir Low Level WRN	Continue	The amount of circulating fluid tank is running low.
07	Reservoir High Level WRN	Continue	The amount of circulating fluid in the tank has increased.
08	Temp. Fuse Cutout FLT	Stop	Temperature of the circulating fluid tank is raised.
09	Reservoir High Temp. FLT	Stop	Temperature of the circulating fluid has exceeded the limitation.
10	Return High Temp. WRN	Continue	Temperature of returning circulating fluid has exceeded the limit.
11	Reservoir High Temp. WRN	Continue	Temperature of the circulating fluid has exceeded the limitation set by the customer.
12	Return Low Flow FLT	Stop	The circulating fluid flow has gone below the limit.
13	Return Low Flow WRN	Continue	Flow rate of the Thermo-chiller has dropped below the set value.
15	Pump Breaker Trip FLT	Stop	The protective equipment in the circulating fluid driving line has started.
17	Interlock Fuse Cutout FLT	Stop	Overcurrent is flown to the control circuit.
18	DC Power Fuse Cutout WRN	Continue	Overcurrent has flowed to the (optional) solenoid valve. (Only for the automatic circulating fluid recovery function - option Z)
19	FAN Motor Stop WRN	Continue	Cooling fan inside the compressor has stopped.
21	Controller Error FLT	Stop	The error occurred in the control systems.
22	Memory Data Error FLT	Stop	The data stored in the controller of this unit went wrong.
23	Communication Error WRN	Continue	The serial communications between this unit and customer's system has been suspended.
24	DI Low Level WRN	Continue	DI level of the circulating fluid has gone below the limitation set by the customer. (Only for DI control kit - option Y)
25	Pump Inverter Error FLT	Stop	The error occurred in the circulating pump inverter. This alarm is applicable to the HRW□□□-H□S only.
26	DNET Comm. Error FLT	Stop	The DeviceNet™ communications between this unit and customer's system has been suspended. (Only for DeviceNet™ communication specification - option D)
27	DNET Comm. Error WRN	Continue	An error has occurred in the DeviceNet™ communication system of this unit. (Only for DeviceNet communication specification - option D)
29	F.Water Low Temp. WRN	Continue	Temperature of facility water has dropped below the set temperature.
30	F.Water High Temp. WRN	Continue	Temperature of facility water has exceeded the set temperature.

# Series HRW Options

Note) Options have to be selected when ordering the thermo-chiller. It is not possible to add them after purchasing the unit.

**C**

Option symbol

## Analogue Communication

HRW  -  - **C**

Analogue communication

In addition to the standard contact input/output signal communication and the serial RS-485 communication, analogue communication function can be added.

The analogue communication function enables to write and read out the following items.

<Writing>

Circulating fluid temperature setting

<Readout>

Circulating fluid present temperature  
Electric resistivity\*

\* Only when the DI control kit (Option "Y") is selected.

Scaling voltage the circulating fluid temperature can be set arbitrarily by the customer.

For details, please consult our "Communication Specifications" information.

**N**

Option symbol

## NPT Fitting

HRW  -  - **N**

NPT fitting

Includes an adapter which converts the connection of the circulating fluid pipe or facility water pipe to NPT thread type. The adapter should be installed on the thermo-chiller by the customer.

**Y**

Option symbol

## DI Control Kit

HRW  -  - **Y**

DI control kit

Select this option if you want to maintain the electric resistivity (DI level) of the circulating fluid at a certain level. However, some components have to be fitted by the customer. For details, refer to the specification table for this option.

Please note that this is not applicable to the fluorinated liquid type.

\* Install the DI filter outside the thermo-chiller for piping. Secure the space for installing the DI filter in the back side of the thermo-chiller.

\* It may go outside of the temperature stability range of  $\pm 0.3^{\circ}\text{C}$  when this option is used in some operating conditions.

**D**

Option symbol

## DeviceNet Communication

HRW  -  - **D**

DeviceNet communication

## DeviceNet<sup>®</sup>

■ Trademark

DeviceNet<sup>®</sup> is a registered trademark of ODVA, Inc.

In addition to the standard contact input/output signal communication and the serial RS-485 communication, the DeviceNet<sup>™</sup> function can be added. The DeviceNet<sup>™</sup> function enables to write and read out the following items.

<Writing>

Run/Stop

Circulating fluid temperature setting

Circulating fluid automatic recovery start/stop\*1

<Readout>

Circulating fluid present temperature

Circulating fluid flow

Circulating fluid discharge pressure

Electric resistivity\*2

Alarm occurrence information

Status (operating condition) information

\*1 Only when the circulating fluid automatic recovery function (Option "Z") is selected.

\*2 Only when the DI control kit (Option "Y") is selected.

For details, please consult our "Communication Specifications" information.

**W**

Option symbol

## SI Unit Only

HRW  -  - **W**

SI unit only

The circulating fluid temperature and pressure are displayed in SI units [MPa/°C] only.


If this option is not selected, a product with a unit selection function will be provided by default.

\* No change in external dimensions

Applicable models		HRW0 <input type="text"/> -H1-Y	HRW0 <input type="text"/> -H2-Y
Allowable circulating fluids	—	Ethylene glycol aqueous solution: 60%	DI water
DI level display range	MΩ cm	0 to 20	
DI level set range	MΩ cm	0 to 20 (Note)	
Solenoid valve hysteresis for control	MΩ cm	0 to 0.9	
DI level reduction alarm set range	MΩ cm	0 to 20	

Note) The DI filter is needed to control the DI level. (SMC Part No.: HRZ-DF001)

Please purchase additionally because the DI filter is not included in this option. Also, if necessary, additionally purchase the insulating material for the DI filter. (SMC Part No.: HRZ-DF002)

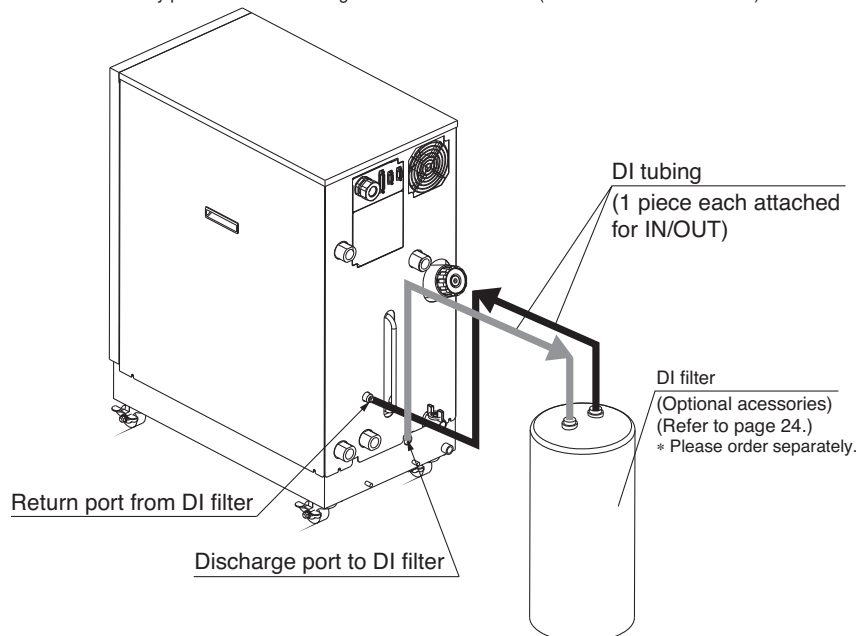

**Z**

Option symbol

**Circulating Fluid Automatic Recovery**


HRW    -       - **Z**

Circulating fluid  
automatic recovery

Select this option for customers who want to use the circulating fluid automatic recovery function.  
The automatic recovery function is a device which can recover the circulating fluid inside pipings into a sub tank of the thermo-chiller by the external communication or operating display panel.  
Some components need to be fitted by the customer. For details, consult “Product Specifications” information for these options.

Applicable models		Common for all models
Circulating fluid recoverable volume <sup>Note 1)</sup>	L	12
Purge gas	—	Nitrogen gas
Purge gas supply port	—	Self-align fitting for O.D. ø8 <sup>Note 2)</sup>
Purge gas supply pressure	MPa	0.4 to 0.7
Purge gas filtration	m	0.01 or less
Regulator set pressure	MPa	0.15 to 0.3 <sup>Note 3)</sup>
Recoverable circulating fluid temperature	°C	10 to 40
Recovery start/stop	—	Start: External communication <sup>Note 4)</sup> or operation display panel / Stop: Automatic
Timeout error	sec	Timer from recovery start to completion Stops recovering when the timer turns to set time. Possible set range: 60 to 300, at the time of shipping from the factory: 300
Height difference with the customer system side	m	10 or less

Note 1) This is the space volume of the sub tank when the liquid level of the circulating fluid is within the specification. A guideline of the recovery volume is 80% of the circulating fluid recoverable volume.  
Note 2) Before piping, clean inside the pipings with air blow, etc. Use the piping with no dust generation to purge gas. When using resin tubing, where necessary, use insert fittings, etc. in order not to deform the tubings when connecting to self-align fittings.  
Note 3) At the time of shipping from factory, it is set to 0.2 MPa.  
Note 4) For details, please consult our “Communication Specifications” information.

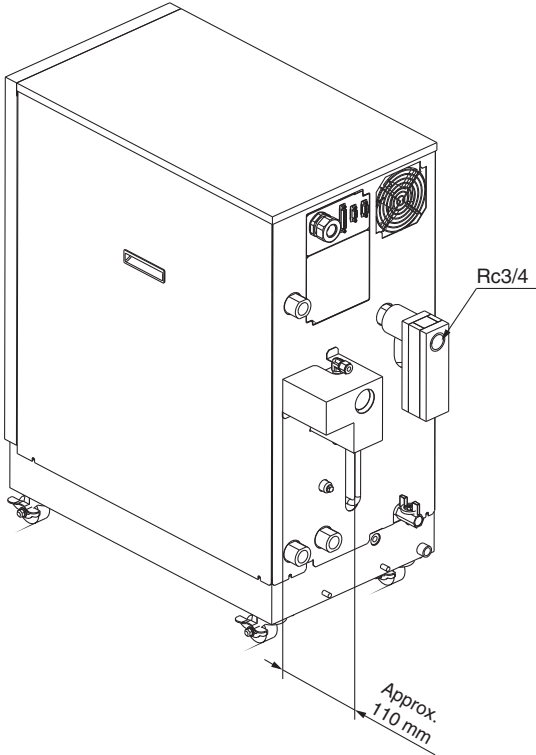

# Series HRW


## Optional Accessories

Note) Necessary to be fitted by the customer.

### Bypass Piping Set

When the circulating fluid goes below the rated flow, the cooling capacity will be reduced and the temperature stability will be badly affected. In such a case, use the bypass piping set.

Part no.	Applicable models
HRW-BP001	Common for all models

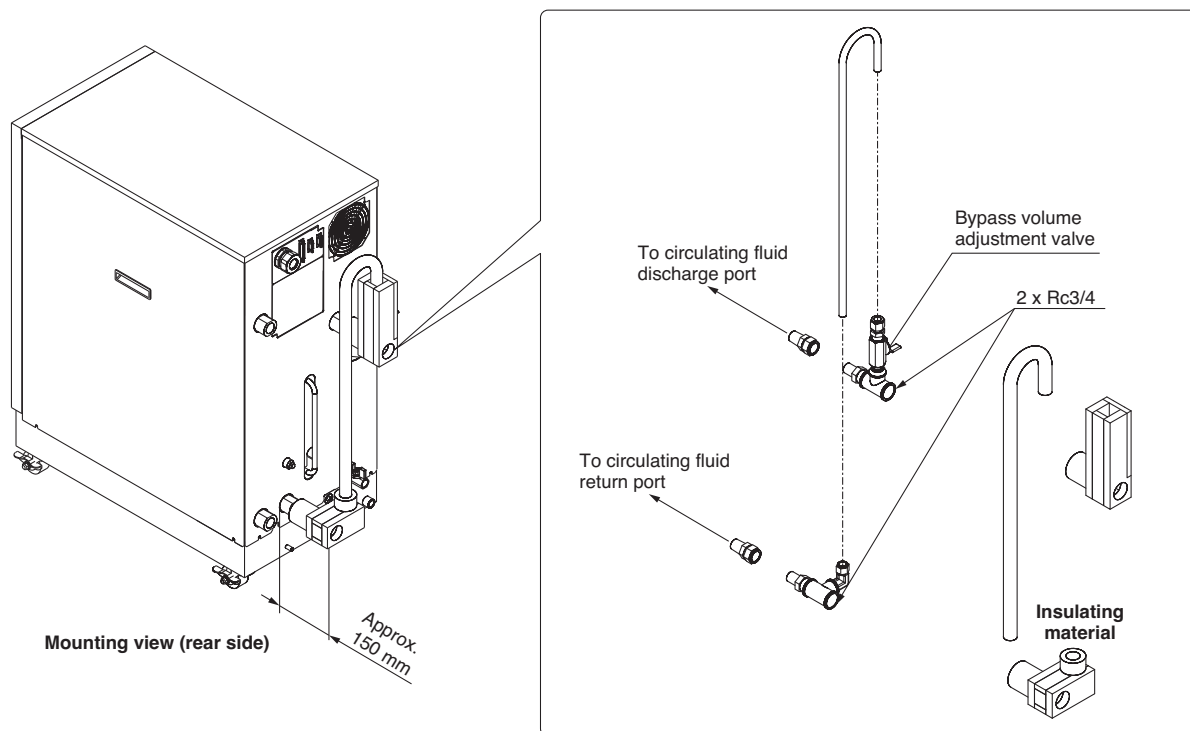


### Anti-quake Bracket

Bracket for earthquakes  
Prepare the anchor bolts (M12) which are suited to the floor material by customer.

Part no.	Applicable models
HRZ-TK002	Common for all models


Note) 2 pieces per set (for 1 unit) (HRZ-TK002)

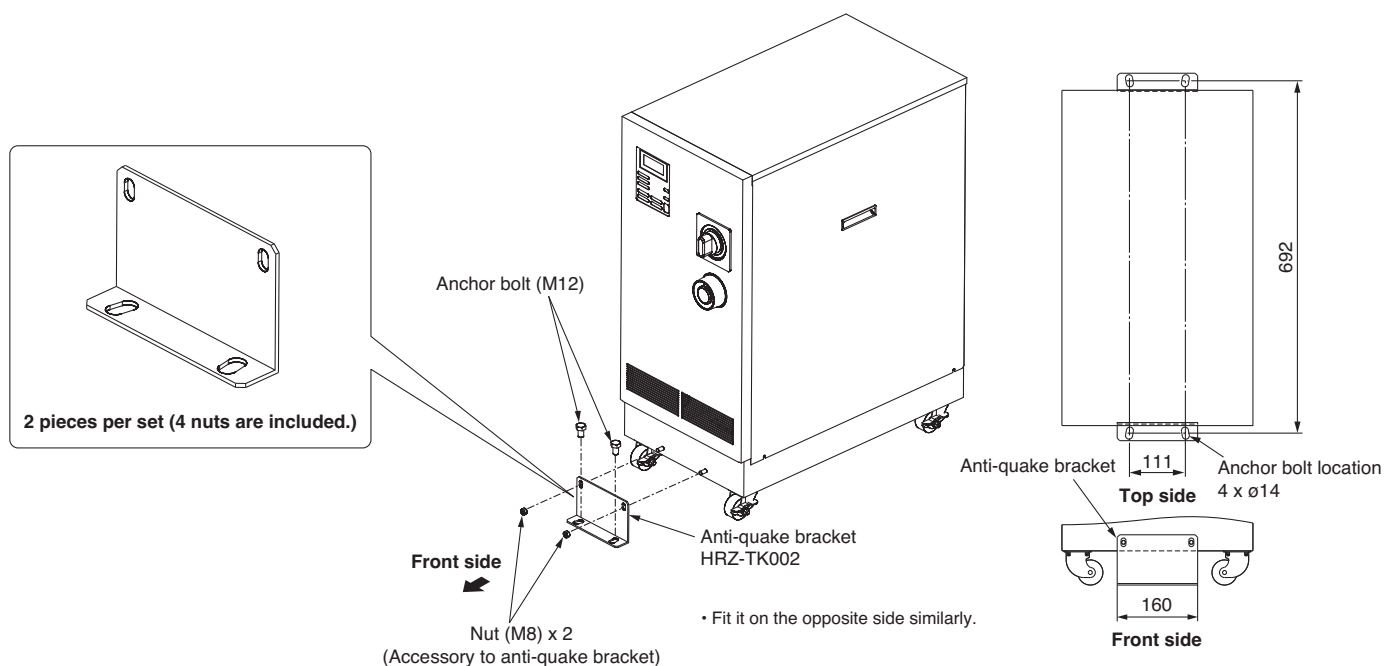

4 Port Manifold

4-branching the circulating fluid enables 4 temperature controls at the maximum with the single unit thermo-chiller. Order the heat insulator for 4 port manifolds (HRW-MA002) separately if necessary.

Part no.	Applicable models
HRW-MA001	Common for all models
HRW-MA002	

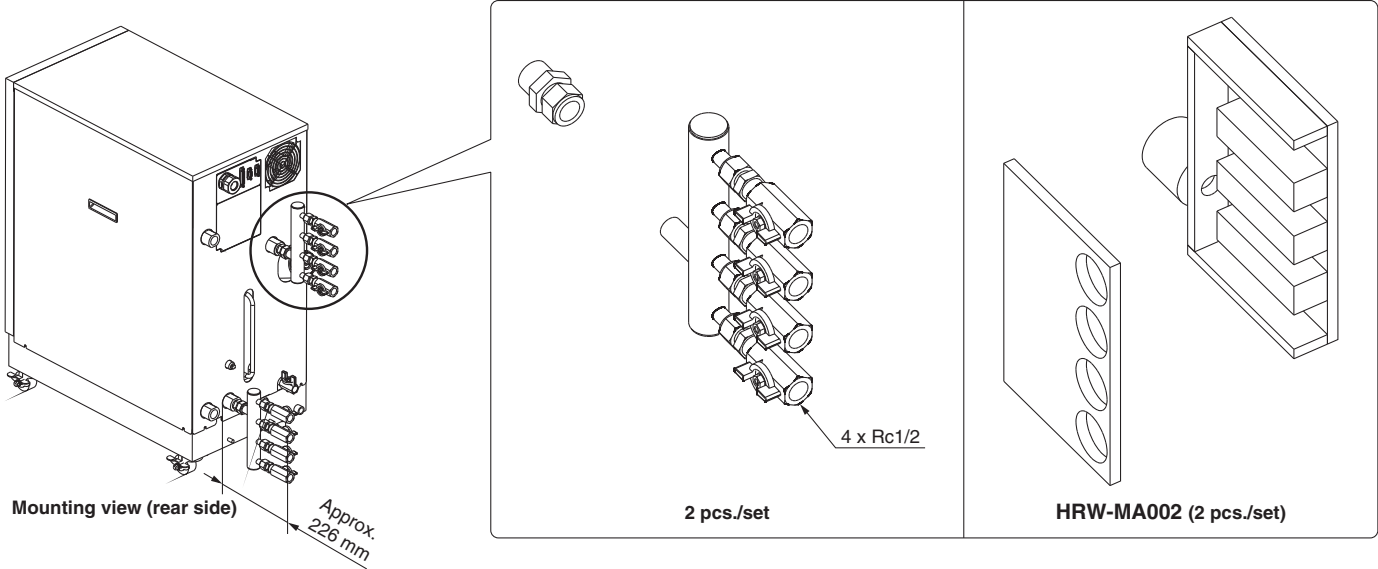


DI Filter

This is the ion replacement resin to maintain the electric resistivity of the circulating fluid. Customers who selected the DI control kit (Option “Y”) need to purchase the DI filter separately.

Part no.	Applicable models
HRZ-DF001	Common for all models which can select the DI control kit. (Option “Y”)

Note) The DI filters are consumable. Depending on the status (electric resistivity set value, circulating fluid temperature, piping volume, etc.), the product life cycles will vary accordingly.

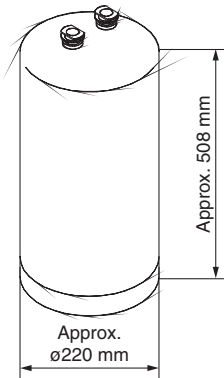


Weight: Approx. 20 kg

Insulating Material for DI Filter

When the DI filter is used at a high temperature, we recommend that you use this insulating material to protect the DI filter from the radiated heat or possible burns. We also recommend that you use this to prevent heat absorption from the DI filter and to avoid forming condensation.

Part no.	Applicable models
HRZ-DF002	Common for all models which can select the DI control kit. (Option “Y”)

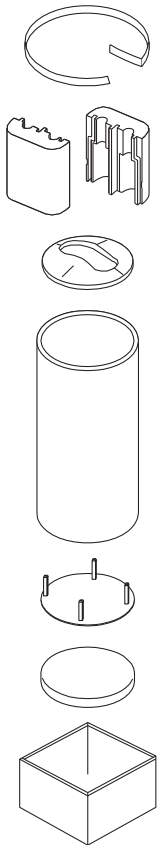


**Contaminant Filter**

A filter mounted in the circulating fluid circuit to eliminate the dust which is contained in the circulating fluid. (Filtration: 20 μm) It is provided with its own heat insulator.

Part no.	Applicable models
<b>HRW-CF001</b>	Common for all models
<b>HRW-CF002</b>	


Note) The internal element of the contaminant filter (part no.: HRW-CF002) is a replacement part. The period in service depends on the operating conditions.

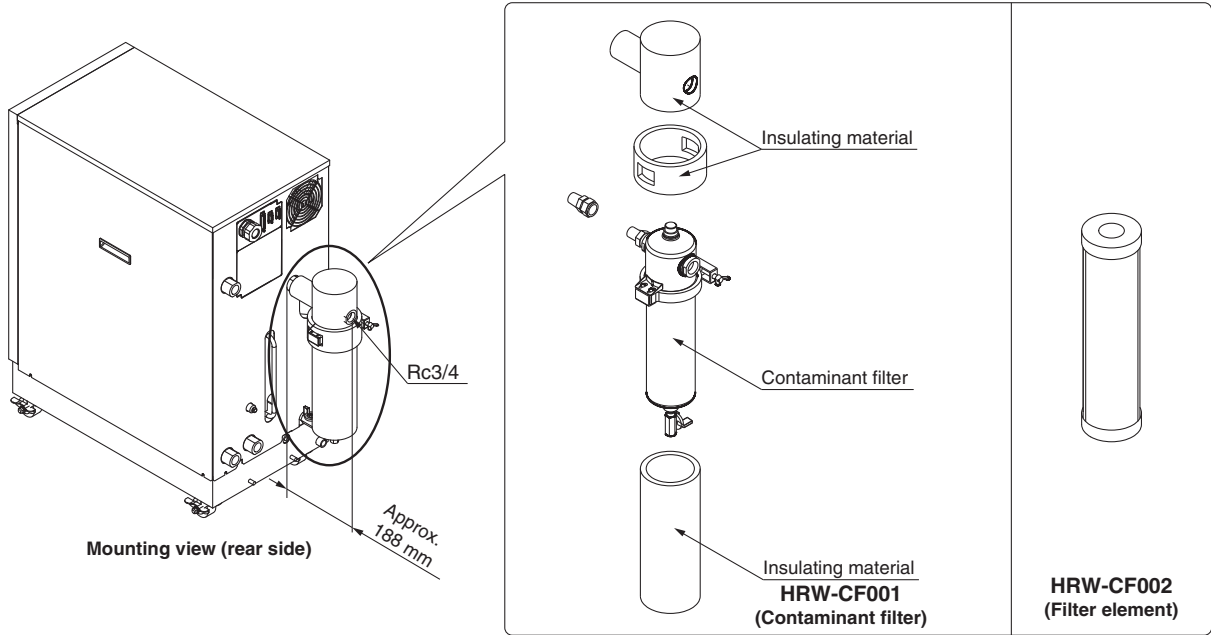

**60% Ethylene Glycol Aqueous Solution**

This solution can be used as a circulating fluid for ethylene glycol-type Thermo-chillers. (Capacity: 10 L)


Part no.	Applicable model
<b>HRZ-BR001</b>	Common for all ethylene glycol-type models

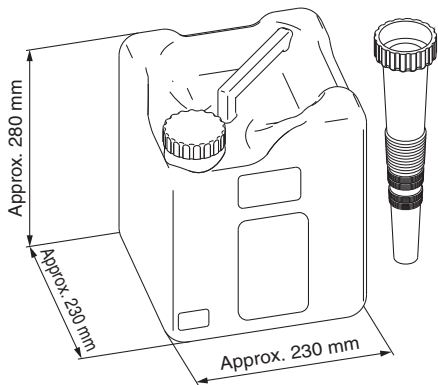

**Concentration Meter**

This meter can be used to control the concentration of ethylene glycol aqueous solution regularly.

Part no.	Applicable model
<b>HRZ-BR002</b>	Common for all ethylene glycol-type models

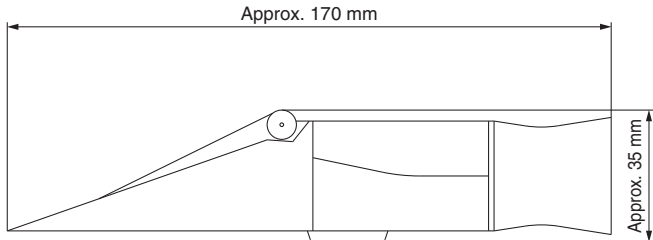



## Series HRW

# Specific Product Precautions 1

Be sure to read this before handling. Refer to back cover for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) and "Operation Manual" for Temperature Control Equipment Precautions. The Operation Manual can be downloaded from the SMC website: <http://www.smc.eu>

### Design

#### ⚠ Warning

##### 1. This catalogue shows the specifications of a single unit.

- For details, please consult our "Product Specifications" and thoroughly consider the adaptability between the customer's system and this unit.
- Although the protection circuit as a single unit is installed, the customer is requested to carry out the safety design for the whole system.

### Selection

#### ⚠ Caution

##### 1. Model selection

In order to select the correct Thermo-chiller model, the amount of thermal generation from the customer's system, the operating circulating fluid, and its circulating flow are required. Select a model, by referring to the guideline to model selection of this catalogue.

##### 2. Option selection

Options have to be selected when ordering the Thermo-chiller. It is not possible to add them after purchasing the unit.

### Handling

#### ⚠ Warning

##### 1. Thoroughly read the Operation Manual.

Read the Operation Manual completely before operation, and keep this manual available whenever necessary.

### Operating Environment/Storage Environment

#### ⚠ Caution

##### 1. Do not use in the following environment because it will lead to a breakdown.

- Environment like written in "Temperature Control Equipment Precautions."
- Locations where spatter will adhere to when welding.
- Locations where it is likely that the leakage of flammable gas may occur.
- Locations where the ambient temperature exceeds the limits as mentioned below.
  - During operation 10°C to 35°C
  - During storage 0°C to 50°C (but as long as water or circulating fluid are not left inside the pipings)
- Locations where the ambient relative humidity exceeds the limit as mentioned below.
  - During operation 30% to 70%
  - During storage 15% to 85%
- (Inside the operation facilities) locations where there is not sufficient space for maintenance.
- In locations where the ambient pressure exceeds the atmospheric pressure.

##### 2. The Thermo-chiller does not have clean room specification. It generates dust from the pump inside the unit and the cooling fan for the unit inside.

### Circulating Fluid

#### ⚠ Caution

- Avoid oil or other foreign objects entering the circulating fluid.
- Use ethylene glycol that does not contain additives such as preservatives.
- The condensation of ethylene glycol aqueous solution must be 60% or less. If the condensation is too high, the pump will be overloaded, resulting in occurrence of "Pump Breaker Trip FLT".
- Avoid water moisture entering the fluorinated fluid.
- Use clear water (including for diluting ethylene glycol aqueous solution) which must meet the water quality standards as mentioned below.

##### Clear Water (as Circulating Fluid) Quality Standards

The Japan Refrigeration and Air Conditioning Industry Association  
JRA GL-02-1994 "Cooling water system – Circulation type – Make-up water"

	Item	Unit	Standard value	Influence	
				Corrosion	Scale generation
Standard item	pH (at 25°C)	—	6.0 to 8.0	○	○
	Electrical conductivity (25°C)	[μS/cm]	100* to 300*	○	○
	Chloride ion (Cl <sup>-</sup> )	[mg/L]	50 or less	○	
	Sulfuric acid ion (SO <sub>4</sub> <sup>2-</sup> )	[mg/L]	50 or less	○	
	Acid consumption amount (at pH4.8)	[mg/L]	50 or less		○
	Total hardness	[mg/L]	70 or less		○
	Calcium hardness (CaCO <sub>3</sub> )	[mg/L]	50 or less		○
Reference item	Ionic state silica (SiO <sub>2</sub> )	[mg/L]	30 or less		○
	Iron (Fe)	[mg/L]	0.3 or less	○	○
	Copper (Cu)	[mg/L]	0.1 or less	○	
	Sulfide ion (S <sub>2</sub> <sup>-</sup> )	[mg/L]	Should not be detected.	○	
	Ammonium ion (NH <sub>4</sub> <sup>+</sup> )	[mg/L]	0.1 or less	○	
	Residual chlorine (Cl)	[mg/L]	0.3 or less	○	
	Free carbon (CO <sub>2</sub> )	[mg/L]	4.0 or less	○	

\* In the case of [MΩcm], it will be 0.003 to 0.01.

N ○: Factors that have an effect on corrosion or scale generation.

N Even if the water quality standards are met, complete prevention of corrosion is not guaranteed.



## HRW Series

# Specific Product Precautions 2

Be sure to read this before handling. Refer to back cover for Safety Instructions, “Handling Precautions for SMC Products” (M-E03-3) and “Operation Manual ” for Temperature Control Equipment Precautions. The Operation Manual can be downloaded from the SMC website: <http://www.smc.eu>

### Facility Water Supply

## Warning

### <Water-cooled refrigeration>

1. The water-cooled refrigeration type thermo-chiller radiates heat to the facility water.

Prepare the facility water system that satisfies the facility water specifications below.

2. When using tap water as facility water, use tap water that conforms to the appropriate water quality standards. Use tap water that conforms to the standards shown below.

### <Tap Water (as Facility Water) Quality Standards>

The Japan Refrigeration and Air Conditioning Industry Association  
JRA GL-02-1994 “Cooling water system – Circulation type – Circulating water”

	Item	Unit	Standard value	Influence	
				Corrosion	Scale generation
Standard item	pH (at 25°C)	—	6.5 to 8.2	○	○
	Electric conductivity (25°C)	[μS/cm]	100*1 to 800*1	○	○
	Chloride ion (Cl <sup>-</sup> )	[mg/L]	200 or less	○	○
	Sulfuric acid ion (SO <sub>4</sub> <sup>2-</sup> )	[mg/L]	200 or less	○	○
	Acid consumption amount (at pH4.8)	[mg/L]	100 or less	○	○
	Total hardness	[mg/L]	200 or less	○	○
	Calcium hardness (CaCO <sub>3</sub> )	[mg/L]	150 or less	○	○
Reference item	Ionic state silica (SiO <sub>2</sub> )	[mg/L]	50 or less	○	○
	Iron (Fe)	[mg/L]	1.0 or less	○	○
	Copper (Cu)	[mg/L]	0.3 or less	○	○
	Sulfide ion (S <sub>2</sub> <sup>-</sup> )	[mg/L]	Should not be detected.	○	○
	Ammonium ion (NH <sub>4</sub> <sup>+</sup> )	[mg/L]	1.0 or less	○	○
	Residual chlorine (Cl)	[mg/L]	0.3 or less	○	○
	Free carbon (CO <sub>2</sub> )	[mg/L]	4.0 or less	○	○

\*1 In the case of [MΩ·cm], it will be 0.001 to 0.01.

— ○: Factors that have an effect on corrosion or scale generation.

— Even if the water quality standards are met, complete prevention of corrosion is not guaranteed.

3. Set the supply pressure between 0.3 to 0.7 MPa. Ensure a pressure difference at the facility water inlet/outlet of 0.3 MPa or more.

If the supply pressure is high, it will cause water leakage. If the supply pressure and pressure difference at the facility water inlet/outlet is low, it will cause an insufficient flow rate of the facility water, and poor temperature control.

### Transportation/Transfer/Movement


## Warning

### 1. Transportation by forklift

1. It is not possible to hang this product.
2. The fork insertion position is either on the left side face or right side face of the unit. Be careful not to bump the fork against a caster or level foot and be sure to put through the fork to the opposite side.
3. Be careful not to bump the fork to the cover panel or piping ports.

### 2. Transportation by casters

1. This product is heavy and should be moved by at least two people.
2. Do not grip the pipings on the rear side or the handles of the panel.

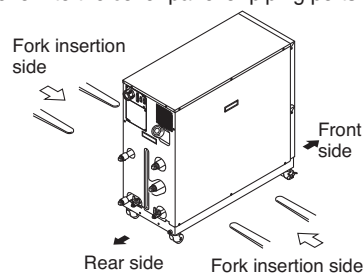

### <When Packaged>

Model	Weigh [kg]	Dimensions [mm] (Width x Depth x Hight)
HRW002-H□	115	550 x 886 x 969
HRW008-H□		
HRW015-H1		
HRW015-H2		
HRW030-H1		
HRW030-H2		
HRW015-H	125	
HRW030-H		
HRW002-H□S	120	
HRW008-H□S		
HRW015-H1S		
HRW015-H2S		
HRW030-H1S		
HRW030-H2S		
HRW015-HS	130	
HRW030-HS		

### Mounting / Installation

## Caution

1. Avoid using this product outdoors.
2. Install on a rigid floor which can withstand this product's weight.
3. Please install a suitable anchor bolt for the anti-quake bracket taking into consideration the customers floor material.
4. Avoid placing heavy objects on this product.





## HRW Series

# Specific Product Precautions 2-1

Be sure to read this before handling. Refer to back cover for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) and "Operation Manual" for Temperature Control Equipment Precautions. The Operation Manual can be downloaded from the SMC website: <http://www.smc.eu>

### Piping

#### Caution

1. **The circulating fluid and facility water piping should be prepared by the customer with consideration of the operating pressure, temperature, and circulating fluid/facility compatibility.**

If the operating performance is not sufficient, the piping may burst during operation. Also, the use of corrosive materials such as aluminum or iron for fluid contact parts, such as the piping, may result in clogging or leakage in the circulating fluid and facility water circuits as well as other unexpected problems. Be sure to take measures to protect the product from corrosion.

2. **The surface of the circulating fluid pipings should be covered with the insulating materials which can effectively confine the heat.**

Absorbing the heat from the surface of pipings may reduce the cooling capacity performance and the heating capacity may be shortened due to heat radiation.

3. **When using fluorinated liquid as the circulating fluid, do not use pipe tape.**

Liquid leakage may occur around the pipe tape.

For sealant, we recommend that you use the following sealant: SMC Part No., HRZ-S0003 (Silicone sealant)

4. **For the circulating fluid pipings, use clean pipings which have no dust, oil or water moisture inside the pipings, and blow with air prior to undertaking any piping works.**

If any dust, oil or water moisture enters the circulating fluid circuit, inferior cooling performance or equipment failure due to frozen water may occur, resulting in bubbles in the circulating fluid inside the tank.

5. **Select the circulating fluid pipings which can exceed the required rated flow.**

For the rated flow, refer to the pump capacity table.

6. **For the circulating fluid piping connection, install a drain pan just in case the circulating fluid may leak.**

7. **Do not return the circulating fluid to the unit by installing a pump in the user system.**

8. **The facility water flow rate is adjusted automatically according to the operating conditions. In addition, the facility water return temperature is 60°C at maximum.**



## Series HRW

# Specific Product Precautions 3


Be sure to read this before handling. Refer to back cover for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) and "Operation Manual" for Temperature Control Equipment Precautions. The Operation Manual can be downloaded from the SMC website: <http://www.smc.eu>

### Electrical Wiring

#### ⚠ Caution

1. Power supply and signal cable should be prepared by the customer.
2. Provide a stable power supply which is not affected by surge or distortion.

If the voltage increase ratio ( $dV/dt$ ) at the zero cross should exceed 40 V/200 sec., it may result in malfunction.




3. This product is installed with a circuit breaker with the following operating characteristics.

For the customer's equipment (primary side), use a breaker whose operating time is equal to or longer than the breaker of this product. If a breaker with shorter operating time is connected, the customer's equipment could be cut off due to the inrush current of the motor of this product.

#### Breaker Operating Characteristics

Common for all models

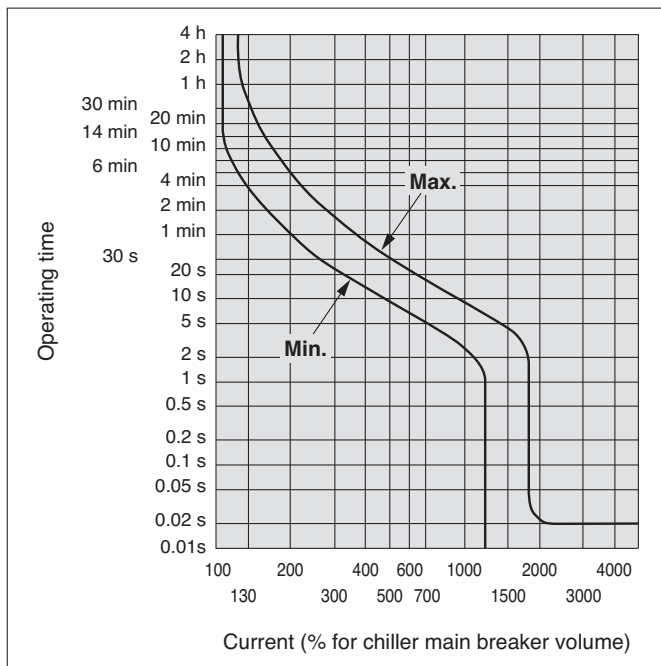

### Operation

#### ⚠ Caution

1. Confirmation before operation

1. The circulating fluid should be within the specified range of "HIGH" and "LOW".
2. Be sure to tighten the cap for the circulating fluid port until the click sound is heard.

2. Emergency stop method

In case of an emergency, press down the EMO switch which is fitted on the front face of this product.

### Maintenance

#### ⚠ Warning

1. Do not operate the switch with wet hands or touch electrical parts such as an electrical plug. This will lead to an electrical shock.
2. Do not splash water directly on this product for cleaning. This will lead to an electrical shock or a fire.
3. When the panel is removed for the purpose of inspection or cleaning, mount the panel after works are done.

If the panel is still open, or running the equipment with the panel removed, it may cause an injury or electric shock.

#### ⚠ Caution

1. In order to prevent a sudden product failure of the unit, replace the replacement parts every 36 months.
2. Perform an inspection of the circulating fluid every 3 months.




1. In case of fluorinated fluids:  
Discharge the circulating liquid and avoid any dirty objects, or water moisture, or foreign objects entering the system.
2. In case of ethylene glycol aqueous solution:  
Density must be 60%.
3. In case of clean water, DI water:  
Replacement is recommended.

3. Check the quality of the facility water every 3 months.

Regarding the water quality standards for facility water, refer to "Temperature Control Equipment Precautions".

## Safety Instructions

These safety instructions are intended to prevent hazardous situations and/or equipment damage. These instructions indicate the level of potential hazard with the labels of “Caution,” “Warning” or “Danger.” They are all important notes for safety and must be followed in addition to International Standards (ISO/IEC) <sup>1)</sup>, and other safety regulations.

-  **Danger:** **Danger** indicates a hazard with a high level of risk which, if not avoided, will result in death or serious injury.
-  **Warning:** **Warning** indicates a hazard with a medium level of risk which, if not avoided, could result in death or serious injury.
-  **Caution:** **Caution** indicates a hazard with a low level of risk which, if not avoided, could result in minor or moderate injury.

- 1) ISO 4414: Pneumatic fluid power – General rules and safety requirements for systems and their components.  
ISO 4413: Hydraulic fluid power – General rules and safety requirements for systems and their components.  
IEC 60204-1: Safety of machinery – Electrical equipment of machines. (Part 1: General requirements)  
ISO 10218-1: Robots and robotic devices - Safety requirements for industrial robots - Part 1: Robots.  
etc.

### Warning

#### 1. The compatibility of the product is the responsibility of the person who designs the equipment or decides its specifications.

Since the product specified here is used under various operating conditions, its compatibility with specific equipment must be decided by the person who designs the equipment or decides its specifications based on necessary analysis and test results. The expected performance and safety assurance of the equipment will be the responsibility of the person who has determined its compatibility with the product. This person should also continuously review all specifications of the product referring to its latest catalogue information, with a view to giving due consideration to any possibility of equipment failure when configuring the equipment.

#### 2. Only personnel with appropriate training should operate machinery and equipment.

The product specified here may become unsafe if handled incorrectly. The assembly, operation and maintenance of machines or equipment including our products must be performed by an operator who is appropriately trained and experienced.

#### 3. Do not service or attempt to remove product and machinery/equipment until safety is confirmed.

1. The inspection and maintenance of machinery/equipment should only be performed after measures to prevent falling or runaway of the driven objects have been confirmed.
2. When the product is to be removed, confirm that the safety measures as mentioned above are implemented and the power from any appropriate source is cut, and read and understand the specific product precautions of all relevant products carefully.
3. Before machinery/equipment is restarted, take measures to prevent unexpected operation and malfunction.

#### 4. Our products cannot be used beyond their specifications.

**Our products are not developed, designed, and manufactured to be used under the following conditions or environments.**

**Use under such conditions or environments is not covered.**

1. Conditions and environments outside of the given specifications, or use outdoors or in a place exposed to direct sunlight.
2. Use for nuclear power, railways, aviation, space equipment, ships, vehicles, military application, equipment affecting human life, body, and property, fuel equipment, entertainment equipment, emergency shut-off circuits, press clutches, brake circuits, safety equipment, etc., and use for applications that do not conform to standard specifications such as catalogues and operation manuals.
3. Use for interlock circuits, except for use with double interlock such as installing a mechanical protection function in case of failure. Please periodically inspect the product to confirm that the product is operating properly.

### Caution

**We develop, design, and manufacture our products to be used for automatic control equipment, and provide them for peaceful use in manufacturing industries.**

**Use in non-manufacturing industries is not covered.**

Products we manufacture and sell cannot be used for the purpose of transactions or certification specified in the Measurement Act.

The new Measurement Act prohibits use of any unit other than SI units in Japan.

## Limited warranty and Disclaimer/Compliance Requirements

The product used is subject to the following “Limited warranty and Disclaimer” and “Compliance Requirements”. Read and accept them before using the product.

### Limited warranty and Disclaimer

1. The warranty period of the product is 1 year in service or 1.5 years after the product is delivered, whichever is first. <sup>2)</sup> Also, the product may have specified durability, running distance or replacement parts. Please consult your nearest sales branch.
2. For any failure or damage reported within the warranty period which is clearly our responsibility, a replacement product or necessary parts will be provided. This limited warranty applies only to our product independently, and not to any other damage incurred due to the failure of the product.
3. Prior to using SMC products, please read and understand the warranty terms and disclaimers noted in the specified catalogue for the particular products.
- 2) Vacuum pads are excluded from this 1 year warranty. A vacuum pad is a consumable part, so it is warranted for a year after it is delivered. Also, even within the warranty period, the wear of a product due to the use of the vacuum pad or failure due to the deterioration of rubber material are not covered by the limited warranty.

### Compliance Requirements

1. The use of SMC products with production equipment for the manufacture of weapons of mass destruction (WMD) or any other weapon is strictly prohibited.
2. The exports of SMC products or technology from one country to another are governed by the relevant security laws and regulations of the countries involved in the transaction. Prior to the shipment of a SMC product to another country, assure that all local rules governing that export are known and followed.

## Safety Instructions

Be sure to read “Handling Precautions for SMC Products” (M-E03-3) before using.

SMC Corporation (Europe)

<b>Austria</b>	+43 (0)2262622800	www.smc.at	office@smc.at
<b>Belgium</b>	+32 (0)33551464	www.smc.be	info@smc.be
<b>Bulgaria</b>	+359 (0)2807670	www.smc.bg	office@smc.bg
<b>Croatia</b>	+385 (0)13707288	www.smc.hr	office@smc.hr
<b>Czech Republic</b>	+420 541424611	www.smc.cz	office@smc.cz
<b>Denmark</b>	+45 70252900	www.smc.dk.com	smc@smcdk.com
<b>Estonia</b>	+372 651 0370	www.smcee.ee	info@smcee.ee
<b>Finland</b>	+358 207513513	www.smc.fi	smc.fi@smc.fi
<b>France</b>	+33 (0)164761000	www.smc-france.fr	supportclient@smc-france.fr
<b>Germany</b>	+49 (0)61034020	www.smc.de	info@smc.de
<b>Greece</b>	+30 210 2717265	www.smchellas.gr	sales@smchellas.gr
<b>Hungary</b>	+36 23513000	www.smc.hu	office@smc.hu
<b>Ireland</b>	+353 (0)14039000	www.smcautomation.ie	sales@smcautomation.ie
<b>Italy</b>	+39 03990691	www.smcitalia.it	mailbox@smcitalia.it
<b>Latvia</b>	+371 67817700	www.smc.lv	info@smc.lv

<b>Lithuania</b>	+370 5 2308118	www.smclt.lt	info@smclt.lt
<b>Netherlands</b>	+31 (0)205318888	www.smc.nl	info@smc.nl
<b>Norway</b>	+47 67129020	www.smc-norge.no	post@smc-norge.no
<b>Poland</b>	+48 222119600	www.smc.pl	sales@smc.pl
<b>Portugal</b>	+351 214724500	www.smc.eu	apoioclientept@smc.smces.es
<b>Romania</b>	+40 213205111	www.smcromania.ro	smcromania@smcromania.ro
<b>Russia</b>	+7 (812)3036600	www.smc.eu	sales@smcru.com
<b>Slovakia</b>	+421 (0)413213212	www.smc.sk	office@smc.sk
<b>Slovenia</b>	+386 (0)73885412	www.smc.si	office@smc.si
<b>Spain</b>	+34 945184100	www.smc.eu	post@smc.smces.es
<b>Sweden</b>	+46 (0)86031240	www.smc.nu	smc@smc.nu
<b>Switzerland</b>	+41 (0)523963131	www.smc.ch	info@smc.ch
<b>Turkey</b>	+90 212 489 0 440	www.smcturkey.com.tr	info@smcturkey.com.tr
<b>UK</b>	+44 (0)845 121 5122	www.smc.uk	sales@smc.uk

<b>South Africa</b>	+27 10 900 1233	www.smcza.co.za	zasales@smcza.co.za
---------------------	-----------------	-----------------	---------------------